



American
ventus
2025






| | | |
|---|--------------------------------|---|
|  | 01 | |
| | VTS Group | |
| | 1.1 | VTS Group 05 |
| | 1.2 | The 3 Elements of Success 08 |
|  | 02 | |
| | Designer support | |
| | 2.1 | ClimaCAD Online 4.0 [CCOL 4] 12 |
| | 2.2 | VTS BIM 14 |
|  | 03 | |
| | Units | |
| | 3.1 | AVS 18 |
| | 3.2 | AVS Lite / AVS Vertical 19 |
| | 3.3 | American Ventus 20 |
| | 3.4 | Design 22 |
| | 3.5 | Air Tightness 24 |
| | 3.5 | Rooftop Applications 26 |
|  | 04 | |
| | Technical Parameters | |
| | 4.1 | AVS 8-55 - Supply & Exhaust 30 |
| | 4.2 | AVS 65-380 - Supply & Exhaust 32 |
| | 4.3 | AVS 8-55 - Cross-Flow Plate 34 |
| | 4.4 | AVS 65-380 - Cross-Flow Plate 38 |
| | 4.5 | AVS 12-65 with Energy Wheel 44 |
| | 4.6 | AVS 85-380 with Energy Wheel 46 |
| | 4.7 | AVS Lite 8-40 - Supply & Exhaust 50 |
| | 4.8 | AVS Lite 8-40 - Cross-Flow Plate 52 |
| | 4.9 | AVS Lite 12-40 with Energy Wheel 55 |
| | 4.10 | AVS - Vertical Configurations 58 |
|  | 05 | |
| | Connection and Controls | |
| | 5.1 | Connecting Point 62 |
| | 5.2 | Construction and Wiring 63 |
| | 5.3 | Controls 64 |
| | 5.4 | Main Elements 65 |
| | 5.5 | Control Applications List 68 |
| | 5.6 | Supply Ahus 69 |
|  | 06 | |
| | Functions | |
| | 6.1 | Functions 78 |
| | 6.2 | Psychrometric Chart 81 |
| | 6.3 | Customer Testimonies 84 |
| | 6.4 | Symbols and Labels 85 |



01
VTS Group

VTS GROUP is a manufacturer of technologically advanced equipment for the HVAC Sector; using innovative technologies in the spheres of project research, production and logistics.

OUR MISSION
AHU#1

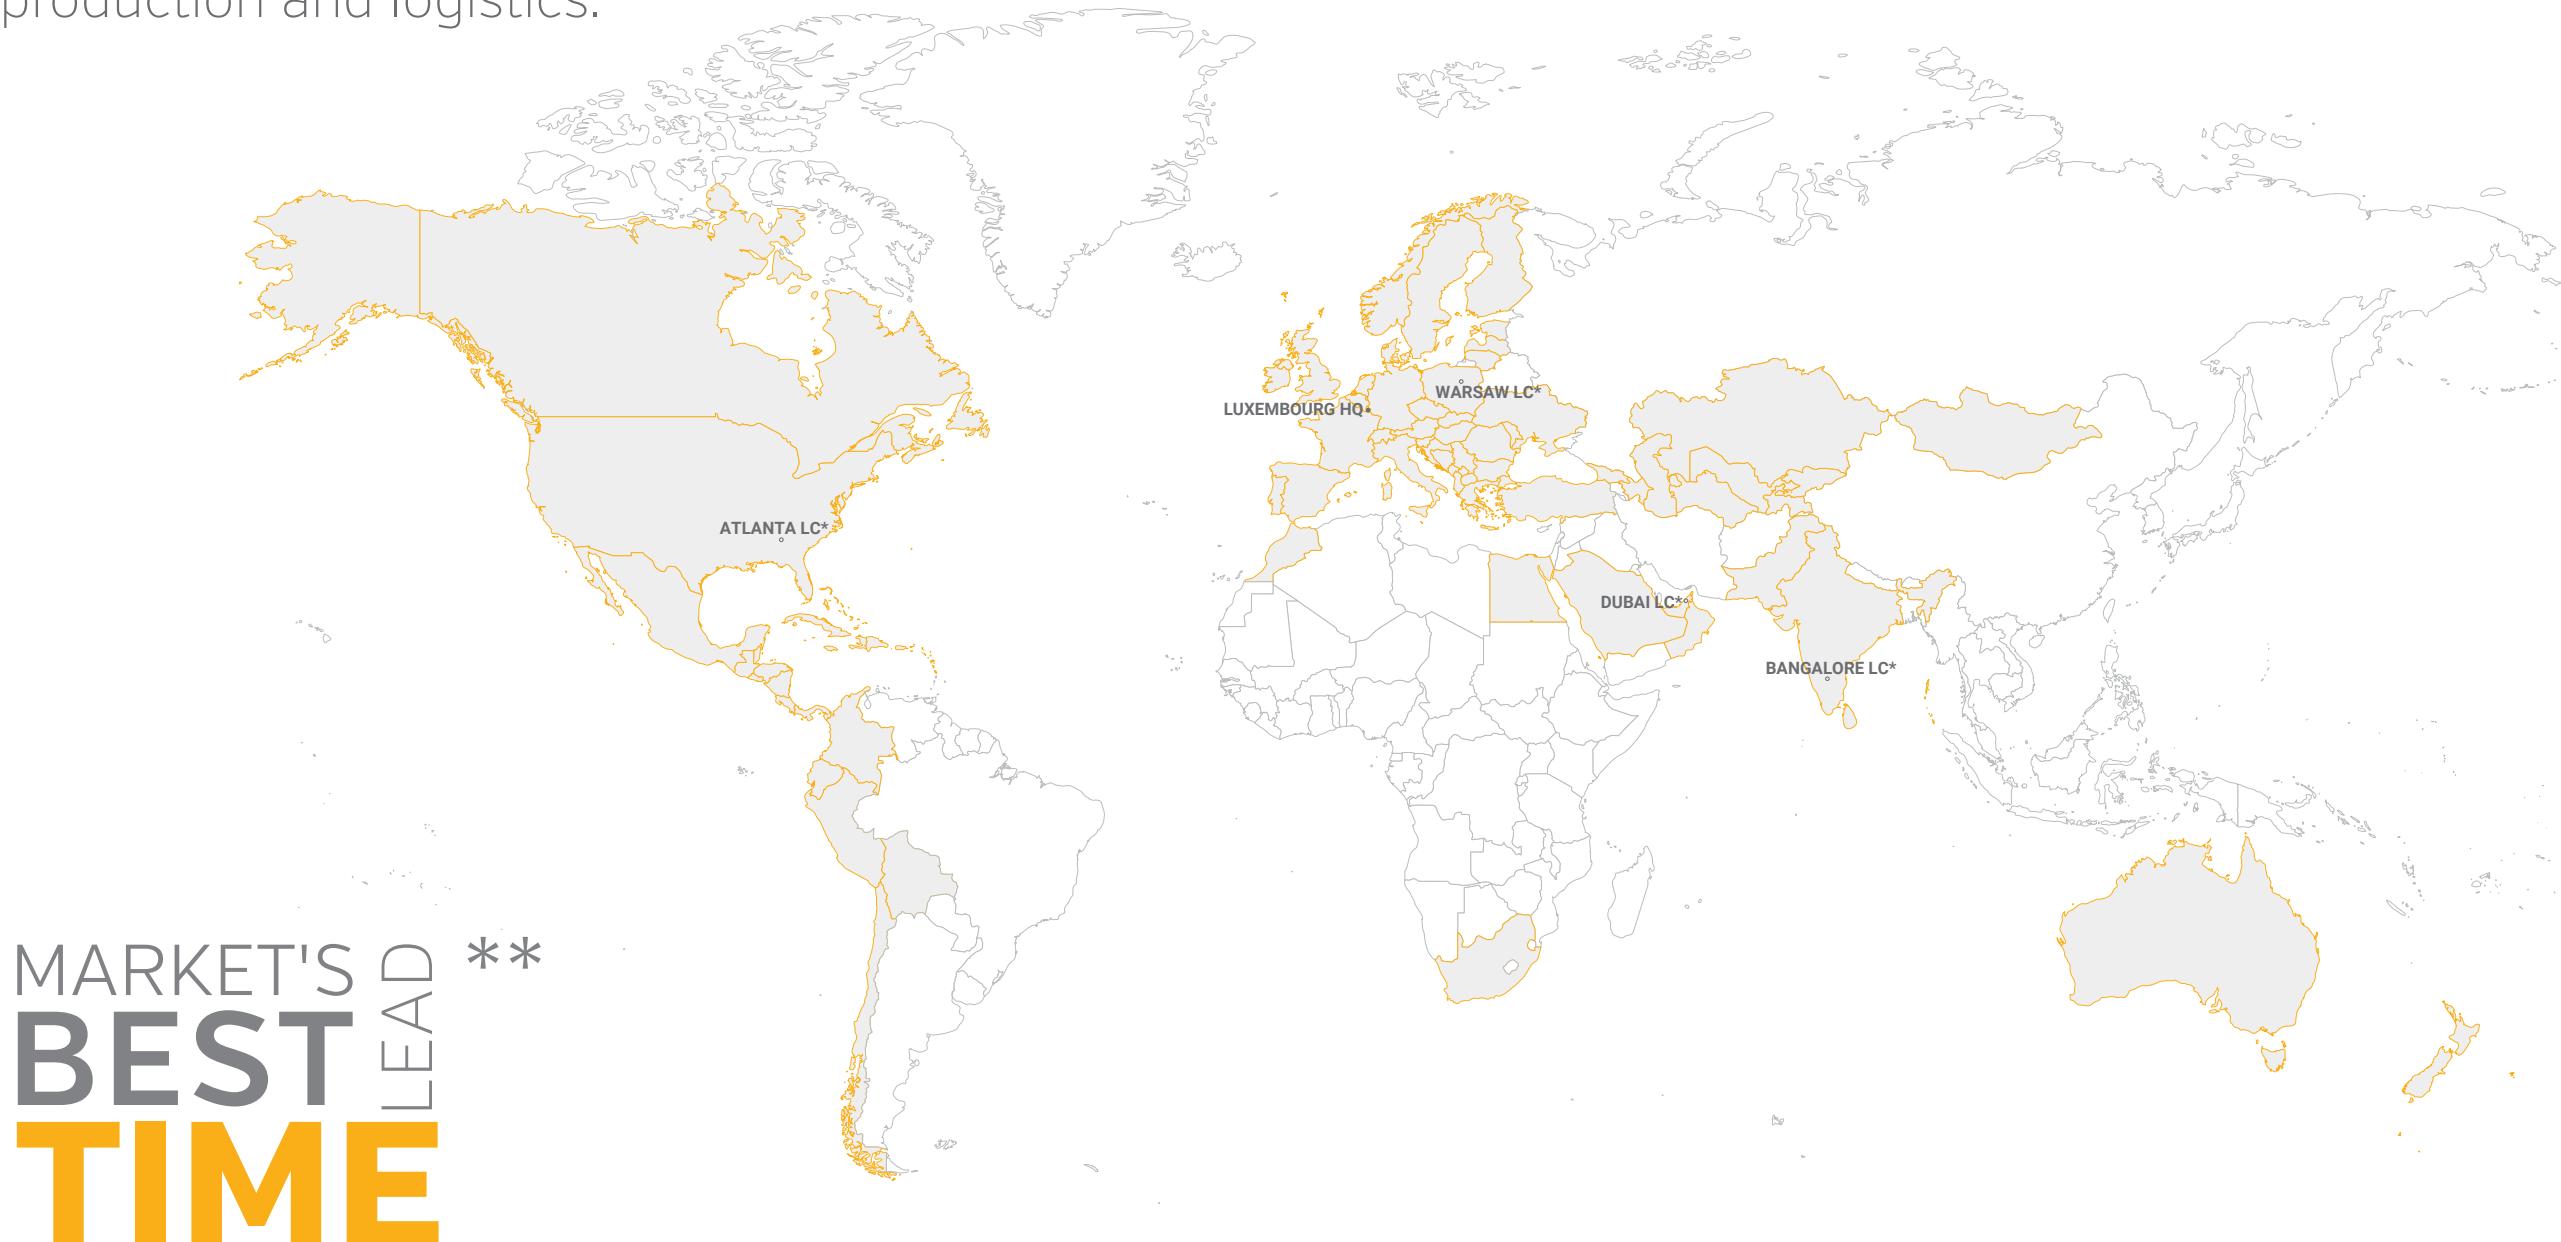

* Logistics center

** Factory will confirm lead time based on the units selected.





THE 3 ELEMENTS OF SUCCESS

Consistently superior product quality. Unbeatable market prices. The shortest lead time. These three elements of market policy ensure that VTS is always one step ahead, in every region of the world.

Following the proven assembly method of the automotive Industry, VTS created a network of 4 efficiently functioning logistics centers: **Atlanta, Dubai, Warsaw and Bangalore**. Thereby guaranteeing the shortest delivery terms in the market, regardless of the region in the world.

Mass scale production of reproducible devices makes it possible for VTS to offer our product at the **most competitive price while retaining the best quality**.

Multilevel quality control systems enables VTS to offer a **18 months warranty for each unit**.

MARKET'S
BEST
TIME^{LEAD}

4^{LOGISTICS}
CENTERS


\$ competitive
price

150 000
UNITS
SOLD ANNUALLY

Q the highest
quality

18^{MONTHS} **warranty**
FOR EACH
UNIT



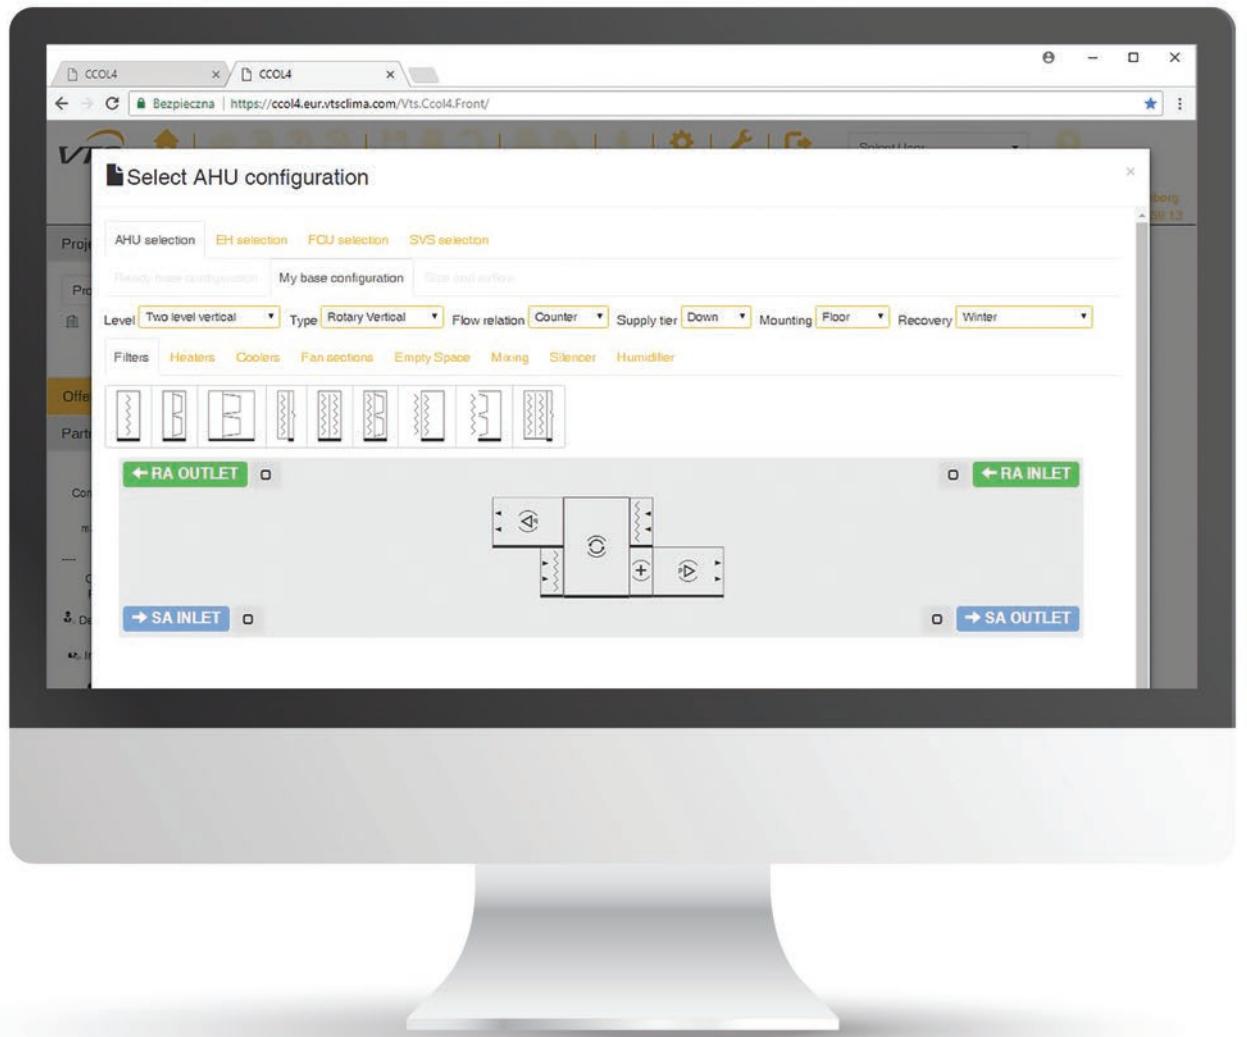


02

Designer support



ClimaCAD Online 4.0 [CCOL 4]

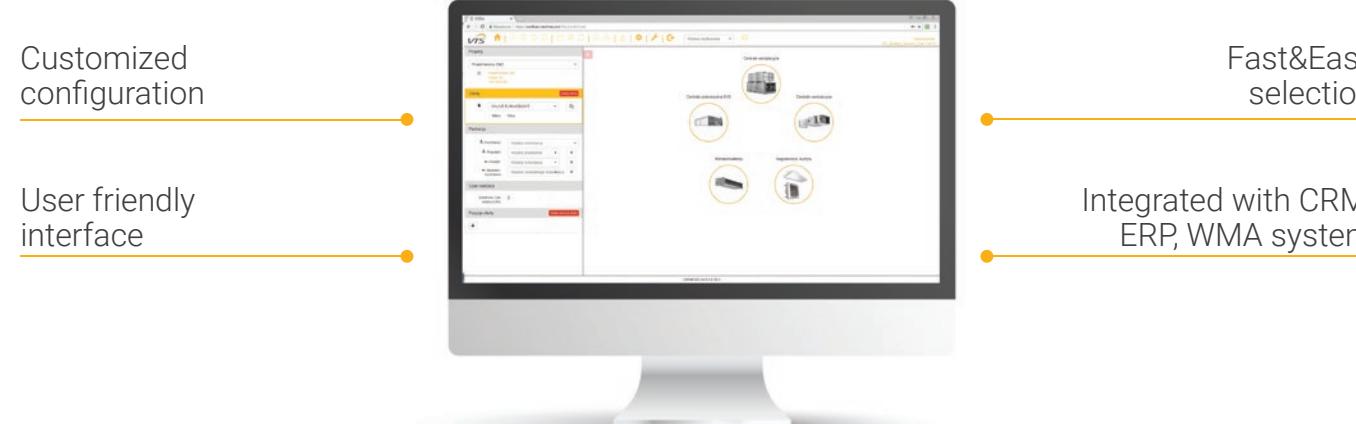

Customized configuration

User friendly interface

Fast&Easy selection

Integrated with CRM,
ERP, WMA system

CCOL 4 IS ADJUST TO

- » all browsers



- » all operating system



- » all devices



DATA EXPORT TO



CCOL 4 uses the latest technology and development platforms, which will be accessible from anywhere in the world through our software as service models. All you need is a device with a web browser and access to the internet.


THE VERSATILITY OF DESIGNING

- » unlimited number of device configurations
- » detection of illogical configurations




DYNAMIC COUNTING OF DEVICES DIMENSIONS

- » CCOL offers the optimal length of the control panel and the optimal section length adapted to the device functions and device design

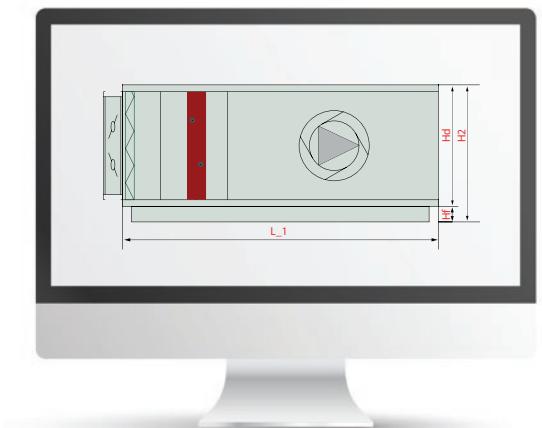

MANAGING YOUR OWN DATABASE

- » the possibility of creating your own project database (selection)
- » the possibility of exporting own selections to quotation by VTS technical engineers

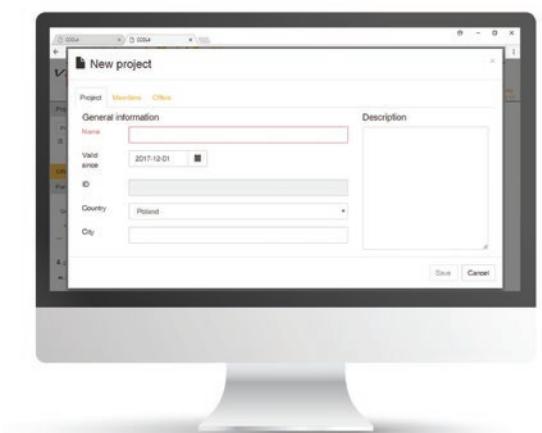


www.ccol4.com




VTS BIM - a new approach to digital models of air-handling units

VTS has created the possibility of generating digital models of VENTUS VS and American VENTUS air-handling models on-line. This is possible thanks to the implementation of a new ClimaCAD OnLine 4.0 selection tool, equipped with .rfa (Revit®) files generator.

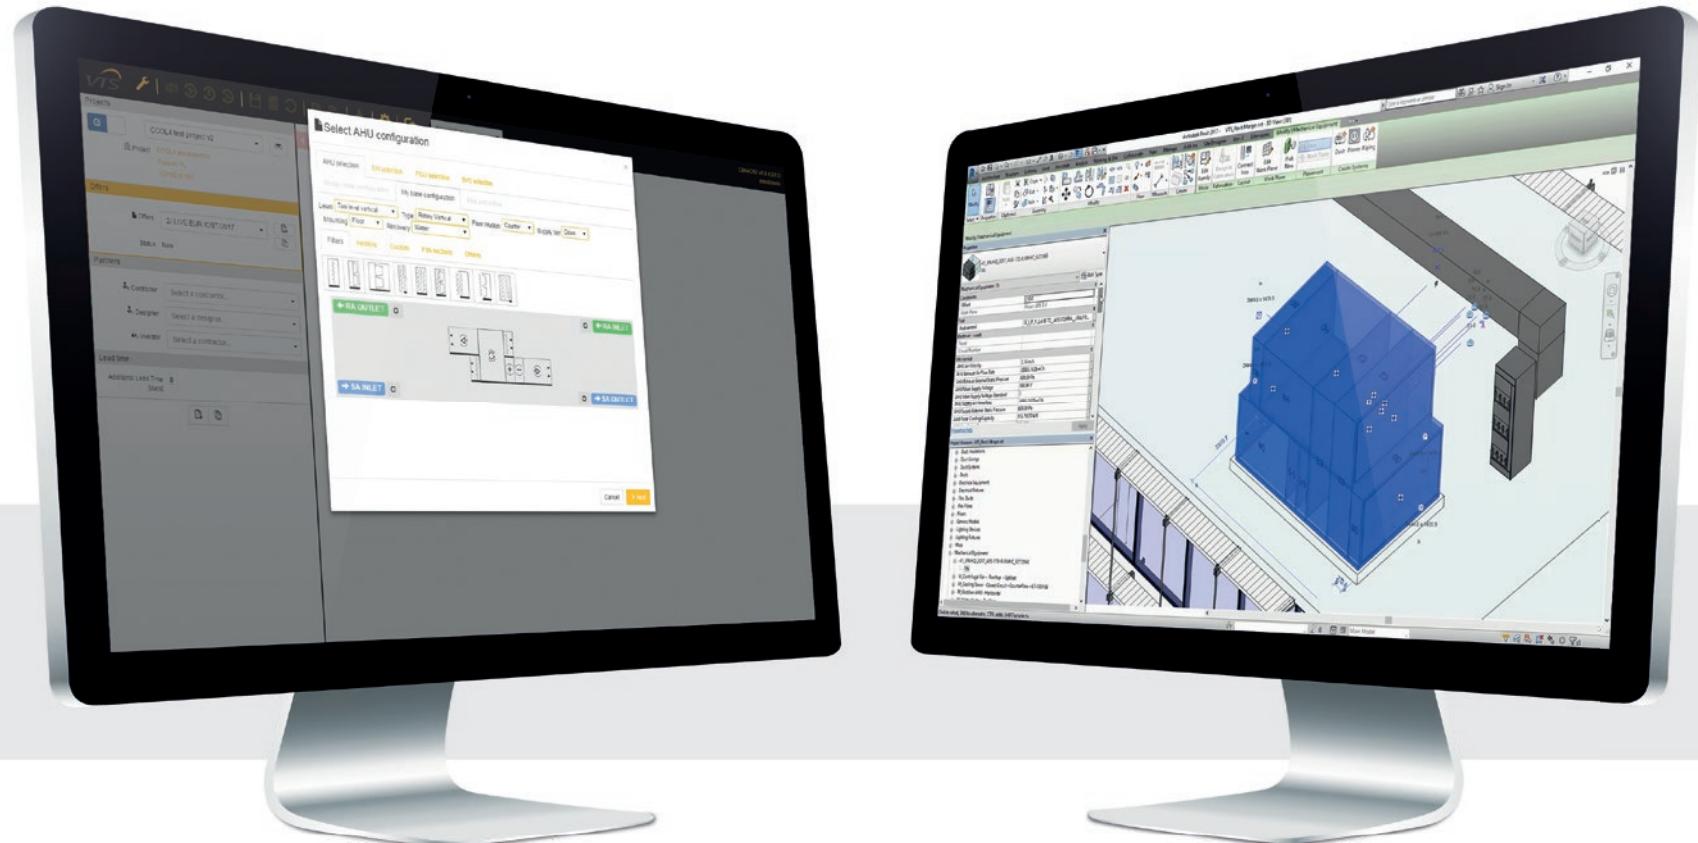


The process of model generation comes down to the following 3 steps:

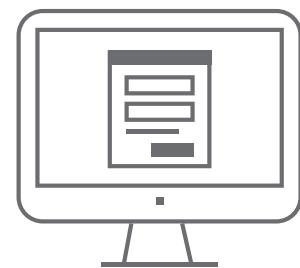

1 Login to CCOL 4.0 website


Login to the CCOL 4.0 using the following web address:

www.ccol4.com

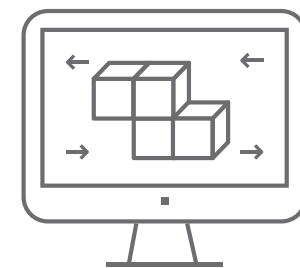

2 Unit configuration




Use the intuitive selection tool to select your Air Handling Unit and set its working parameters to fit the specified project demands.

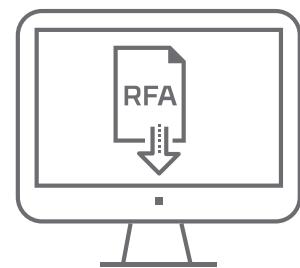

3 Data export to .rfa file

In order to generate a model in .rfa file, it is enough to enter the name and surname plus the email address of the person dedicated to receive the file. The system will automatically send a link to download the model. The entire process lasts approximately 15 minutes.

As a result, the client receives:

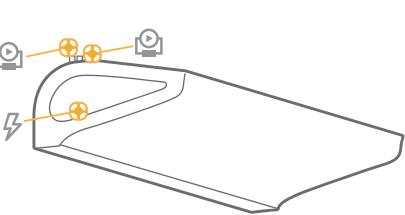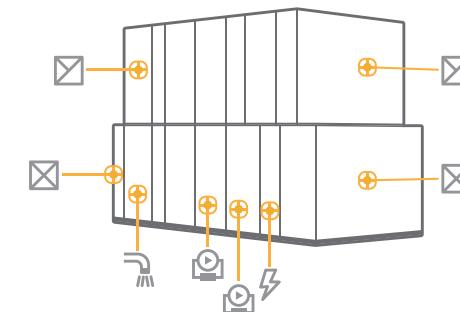

The generated objects contain detailed parameters connectors:

- » **air systems,**
- » **hydraulic systems,**
- » **sanitary systems,**
- » **electric systems,**

as well as the complete dimensional data, the device **maintenance** zone and the service (**repair**) zone.

VTS also provides digital models of WING air curtains and VOLCANO air heaters.

The models contain:

- » **parametrized electric and hydraulic connectors,**
- » **mount options vertically and horizontally,**
- » **presentation of the range of air stream,**
- » **parameter of any inclination angle of an air heater in relation to the horizontal plane.**

Models can be downloaded from: <https://vtsgroup.com/us/vts-bim>



 03
Units



AVS



from **800 CFM**
to **38 000 CFM**
in total **capacity**




premium efficiency motors energy recovery system:

- cross-flow plate
- energy wheel



2 000 h
salt spray test
resistance
on the external coating

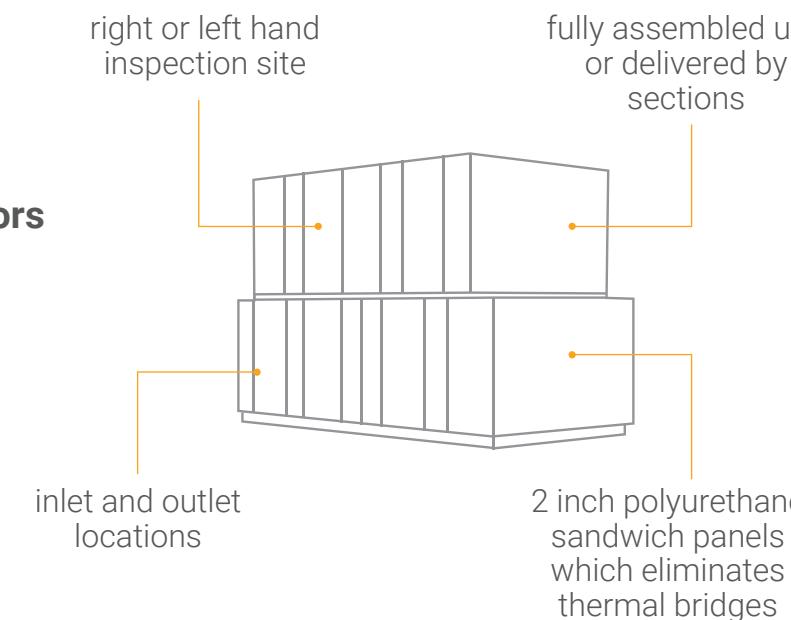

AVS LITE



from **800 CFM**
to **4 000 CFM**
in total **capacity**




premium efficiency motors energy recovery system:

- cross-flow plate
- energy wheel



2 000 h
salt spray test
resistance
on the external coating

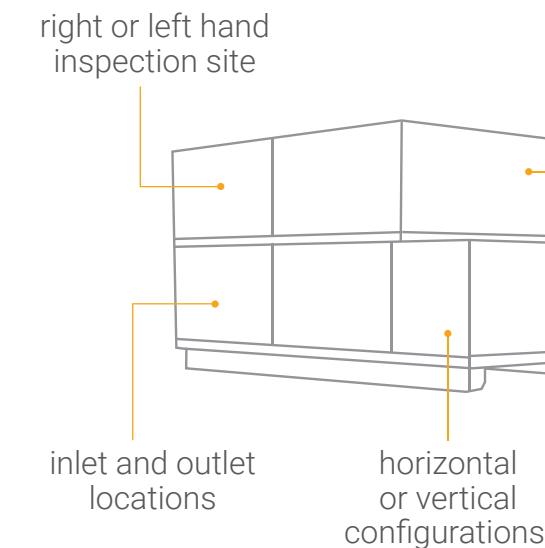

AVS VERTICAL




from **800 CFM**
to **4 000 CFM**
in total **capacity**



premium efficiency motors



2 000 h
salt spray test
resistance
on the external coating

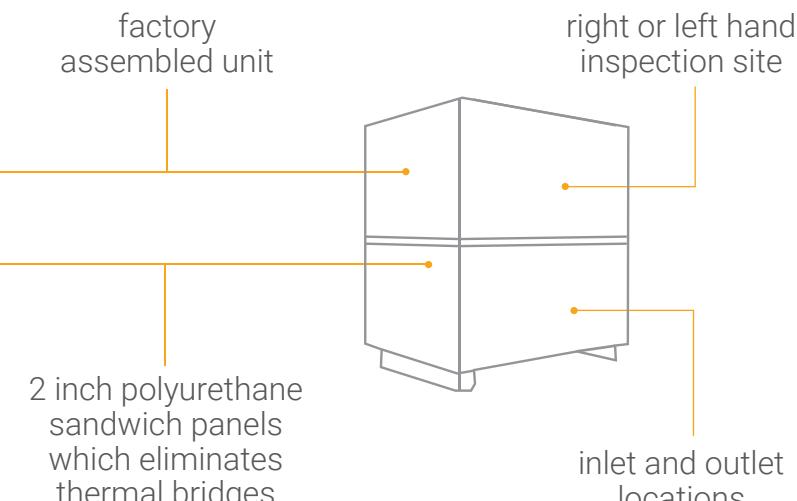



American
ventus



RELIABLE
AND TIGHT
CONSTRUCTION



TOP QUALITY
COMPONENTS



INTELLIGENT
CONTROLS
SYSTEMS




SAFETY
OF USE

DESIGN



MORE THAN 2,000 HOURS SALT SPRAY TEST PROTECTION

RESISTANCE TO CORROSION

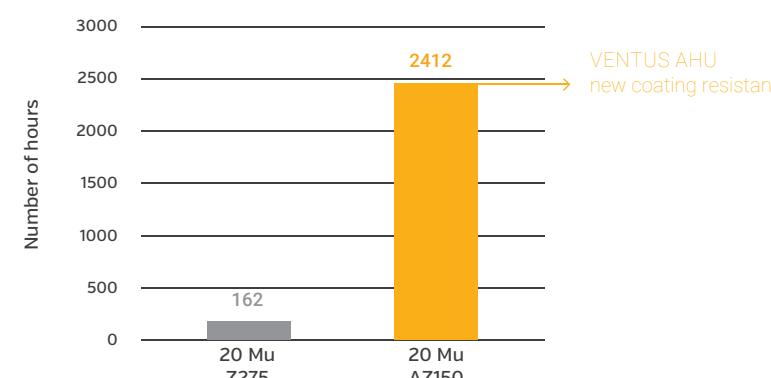

CASING SKIN

- » high rigidity and durability of the AHU structure
- » low absorption of heat radiation and UV
- » perfect resistance to weather conditions



FAN SECTION CAGE

- » high longitudinal stiffness of the structure
- » easy section assembly



Z PROFILE

AVS040-AVS085



C PROFILE

AVS100-AVS380



CURB READY RAILS

AVS040-AVS380

GALVANIZED STEEL SUPPORT AS STANDARD FOR ALL TYPES OF UNITS

CONVENIENT

- » easy transport
- » great profile resistance to deflection



ALUMINUM POSTS AS STANDARD FOR ALL TYPES OF UNITS

AIR TIGHTNESS



ERGONOMIC INSPECTION PANEL LOCK


» Highly aesthetic and ergonomic handles securing perfect tightness of inspection panels.

* patent pending; information will be published after its formal validation.




ALUMINUM STRUCTURAL POSTS WITH AN ADDITIONAL SEALING FIN AND A THERMAL INSERT


- » thermal break as standard - ensures no condensation outside the AHU
- » the fin ensures labyrinth sealing – currently the most effective solution on the market, mainly used in laboratory equipment
- » original solution consisting in the use of symmetrical channel tension filled with a sealing compound, which provides 100% tightness of the connection between the column and construction structure

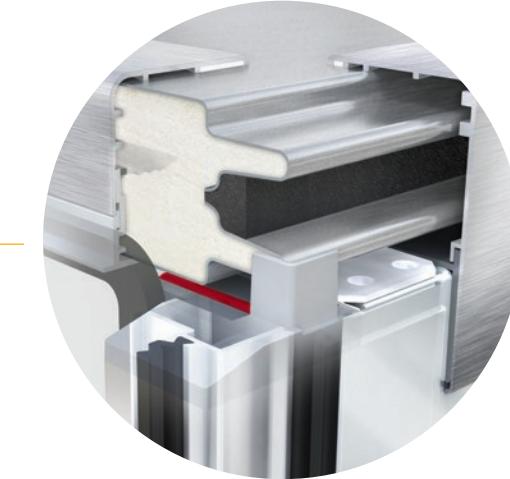


THERMAL BREAK

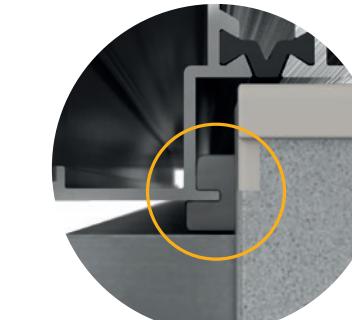

LABYRINTH SEALING

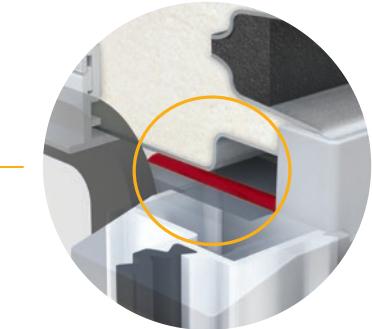

ADDITIONAL POST SEALING

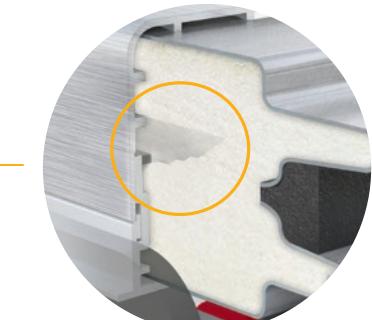

ADDITIONAL SEALING EDGE

ROOFTOP APPLICATIONS



SECTIONAL ROOF

- » prevents water penetration during service
- » additional weather protection



VARIABLE INTAKE CONFIGURATIONS

- » top, bottom and side intake options
- » end – optional full face intake damper available units
- » dampers:
 - gear system for even distribution of the torque
 - extruded aluminum construction
 - low leakage
 - double wall blade construction



CURB READY RAILS

- » design -overhangs the side of the curb to avoid the need of flashing
- » integrated lifting lugs



VARIABLE DISCHARGE CONFIGURATION

- » end, top, bottom and side discharge options
- » optional discharge dampers and full end discharge dampers available





04



Technical
Parameters

AVS 8-55 - SUPPLY & EXHAUST

| Rated parameters | | Recommended range of airflow | | | | | | |
|--|------------------|------------------------------|---------|---------|---------|---------|---------|---------|
| Size | | AVS 008 | AVS 012 | AVS 016 | AVS 020 | AVS 030 | AVS 040 | AVS 055 |
| 15 000 | [CFM] | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| 10 000 | | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| 5 000 | | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| 0 | | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| Min. | | 332 | 427 | 427 | 480 | 618 | 618 | 636 |
| Max. | | 2140 | 1883 | 1254 | 924 | 3091 | 2719 | 1817 |
| H _f | | | | | | | | 3.54 |
| H | | 21.97 | 21.97 | 24.02 | 27.17 | 32.48 | 37.20 | 41.14 |
| W | | 27.95 | 38.62 | 44.21 | 46.77 | 53.50 | 59.06 | 66.14 |
| W _i | | 24.02 | 34.68 | 40.28 | 42.83 | 49.57 | 55.12 | 62.20 |
| H _i | | 14.49 | 14.49 | 16.54 | 19.69 | 25.00 | 29.72 | 33.66 |
| Main configuration DE* | | Basic configurations | | | | | | |
| AVS-XXX-R-V | - | 44.26 | 44.26 | 44.26 | 44.26 | 58.65 | 58.65 | 73.05 |
| AVS-XXX-R-FV | - | 58.65 | 58.65 | 58.65 | 58.65 | 73.05 | 73.05 | 87.45 |
| AVS-XXX-R-FHV | - | 73.05 | 73.05 | 73.05 | 73.05 | 87.45 | 87.45 | 101.85 |
| AVS-XXX-R-FCV | ✓ | 73.05 | 73.05 | 73.05 | 73.05 | 87.45 | 87.45 | 101.85 |
| AVS-XXX-R-FHCV | ✓ | 87.45 | 87.45 | 87.45 | 87.45 | 87.45 | 87.45 | 101.85 |
| AVS-XXX-R-FHCV | ✓ | 87.45 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 |
| AVS-XXX-R-FHCV | ✓ | 101.85 | 101.85 | 101.85 | 101.85 | 101.85 | 101.85 | 116.24 |
| AVS-XXX-R-FGHV | - | 101.85 | 101.85 | 101.85 | 101.85 | 116.24 | 116.24 | 130.64 |
| AVS-XXX-R-FGV | - | 116.24 | 116.24 | 116.24 | 116.24 | 116.24 | 116.24 | 130.64 |
| AVS-XXX-R-FGVH | ✓ | 87.45 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 |
| AVS-XXX-R-FGVH | - | 73.05 | 73.05 | 73.05 | 73.05 | 87.45 | 87.45 | 101.85 |
| AVS-XXX-R-FGVH | ✓ | 101.85 | 101.85 | 101.85 | 101.85 | 116.24 | 116.24 | 130.64 |
| AVS-XXX-R-FGVH | ✓ | 116.24 | 116.24 | 116.24 | 116.24 | 116.24 | 116.24 | 130.64 |
| Units with external filters instead of internal are shorter by 14.4 inches | | | | | | | | |
| Additional functions | | | | | | | | |
| Empty section | L _{min} | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| Empty section | L _{max} | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| Mixing box | L | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |

* Include Droplet Eliminator after Cooling Coil

DIMENSIONS - AVS 8-55 - SUPPLY & EXHAUST

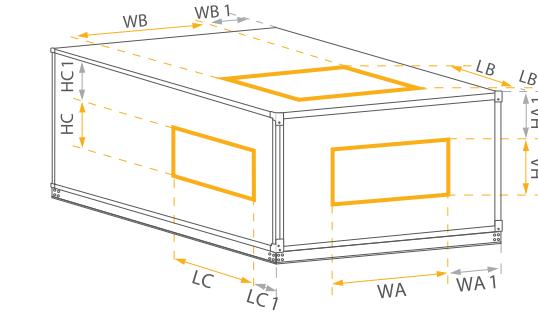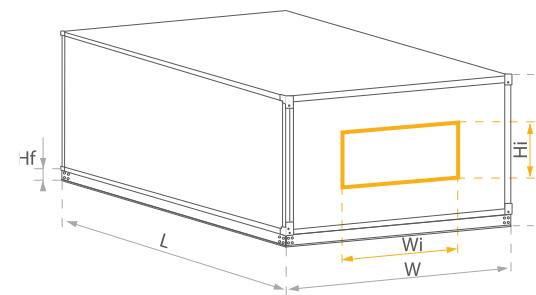

AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | | |
|---------------|-------|-------|------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 008 | 21.65 | 12.13 | 3.15 | 3.15 |
| AVS 012 | 32.32 | 12.13 | 3.15 | 3.15 |
| AVS 016 | 37.91 | 14.17 | 3.15 | 3.15 |
| AVS 020 | 40.47 | 17.32 | 3.15 | 3.15 |
| AVS 030 | 47.20 | 22.64 | 3.15 | 3.15 |
| AVS 040 | 52.76 | 27.36 | 3.15 | 3.15 |
| AVS 055 | 59.84 | 31.30 | 3.15 | 3.15 |

| END (FS) | | | | |
|----------|-------|-------|-------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 008 | 17.99 | 7.99 | 5.03 | 5.23 |
| AVS 012 | 25.98 | 7.99 | 6.33 | 5.23 |
| AVS 016 | 34.02 | 7.99 | 5.13 | 6.23 |
| AVS 020 | 25.98 | 12.01 | 10.43 | 5.83 |
| AVS 030 | 34.02 | 12.01 | 9.83 | 8.53 |
| AVS 040 | 40.47 | 17.32 | 9.29 | 8.19 |
| AVS 055 | 47.20 | 22.64 | 9.47 | 7.48 |

| Top (US) | | | | |
|----------|-------|-------|-------|------|
| UNIT | WB | LB | WB1 | LB1 |
| AVS 008 | 17.99 | 7.99 | 5.03 | 4.33 |
| AVS 012 | 25.98 | 7.99 | 6.33 | 4.33 |
| AVS 016 | 34.02 | 7.99 | 5.13 | 4.33 |
| AVS 020 | 25.98 | 12.01 | 10.43 | 4.33 |
| AVS 030 | 34.02 | 12.01 | 9.83 | 4.33 |
| AVS 040 | 40.47 | 17.32 | 9.29 | 8.27 |
| AVS 055 | 47.20 | 22.64 | 9.47 | 5.31 |

| Top (US) | | | | |
|----------|-------|-------|-------|-------|
| UNIT | WB | LB | WB1 | LB1 |
| AVS 008 | 17.94 | 7.94 | 5.00 | 11.46 |
| AVS 012 | 25.94 | 7.94 | 6.34 | 11.46 |
| AVS 016 | 33.94 | 7.94 | 5.16 | 11.46 |
| AVS 020 | 25.94 | 11.94 | 10.43 | 9.46 |
| AVS 030 | 33.94 | 11.94 | 9.80 | 9.46 |
| AVS 040 | 47.20 | 22.64 | 5.93 | 8.66 |
| AVS 055 | 52.76 | 27.36 | 6.69 | 8.66 |

UNIT CODING

AVS - XXX - R/L - EM / HC / EM

AVS - type of AHU family
 XXX - size of unit (equal to the rated air flow in cfm)
 R/L - inspection side (R-right, L-left)
 EM - symbols of additional functions upstream main functions
 HC - symbols of main thermodynamic functions (basic functions)
 EM - symbols of additional functions downstream main functions
 Length depends on AHU equipment



| Side (BS) | | | | | |
|-----------|-------|-------|------|------|--|
| UNIT | HC | LC | HC1 | LC1 | |
| AVS 008 | 10.94 | 7.94 | 4.33 | 3.74 | |
| AVS 012 | 10.94 | 7.94 | 4.33 | 3.74 | |
| AVS 016 | 12.94 | 7.94 | 4.33 | 3.74 | |
| AVS 020 | 15.94 | 11.94 | 4.33 | 3.82 | |
| AVS 030 | 20.94 | 11.94 | 4.33 | 3.98 | |
| AVS 040 | 16.26 | 14.96 | 6.89 | 8.70 | |
| AVS 055 | 24.13 | 14.96 | 6.89 | 6.73 | |

AVS 65-380 - SUPPLY & EXHAUST

| Rated parameters | | Recommended range of airflow | | | | | | | | |
|--|------------------|------------------------------|--------|--------|--------|--------|--------|--------|--------|-------|
| Size | | AVS065 | AVS085 | AVS100 | AVS130 | AVS170 | AVS230 | AVS300 | AVS380 | |
| 75 000 | [CFM] | 12395 | 3307 | 3307 | 2952 | 4069 | 4069 | 3559 | 4501 | 4501 |
| 50 000 | | 14402 | 14553 | 10640 | 7840 | 18983 | 17907 | 13199 | 9725 | 22883 |
| 25 000 | | 11809 | 16026 | 27540 | 21909 | 19807 | 16026 | 35731 | 49513 | 35576 |
| 0 | | 26348 | 19414 | 49540 | 45883 | 35609 | 26238 | 57783 | 53531 | 43761 |
| Min. | | 2395 | 3307 | 3307 | 2952 | 4069 | 4069 | 3559 | 4501 | 4501 |
| Max. | | 15402 | 14553 | 10640 | 7840 | 18983 | 17907 | 13199 | 9725 | 22883 |
| H _f | | 3.54 | | | | | 3.15 | | | |
| H | | 42.60 | 46.57 | 54.21 | 54.21 | 65.98 | 75.16 | 75.16 | 93.94 | |
| W | | 75.24 | 82.87 | 82.87 | 98.94 | 102.56 | 122.24 | 141.93 | 146.34 | |
| W _i | | 71.30 | 78.94 | 78.94 | 95.00 | 98.62 | 118.31 | 137.99 | 142.40 | |
| H _i | | 35.12 | 39.09 | 47.13 | 47.13 | 58.90 | 68.07 | 68.07 | 86.85 | |
| Main configuration | DE* | Basic configurations | | | | | | | | |
| | - | 73.05 | 73.05 | 58.65 | 58.65 | 73.05 | 73.05 | 73.05 | 73.05 | |
| | - | 87.45 | 87.45 | 73.05 | 73.05 | 87.45 | 87.45 | 87.45 | 87.45 | |
| | - | 101.85 | 101.85 | 87.45 | 87.45 | 101.85 | 101.85 | 101.85 | 101.85 | |
| | ✓ | 101.85 | 101.85 | 87.45 | 87.45 | 101.85 | 101.85 | 101.85 | 101.85 | |
| | - | 116.24 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 | |
| | ✓ | 116.24 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 | |
| | - | 130.64 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 | |
| | ✓ | 130.64 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 | |
| | - | 116.24 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 | |
| | - | 101.85 | 101.85 | 87.45 | 87.45 | 101.85 | 101.85 | 101.85 | 101.85 | |
| | - | 130.64 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 | |
| | ✓ | 130.64 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 | |
| Units with external filters instead of internal are shorter by 14.4 inches | | | | | | | | | | |
| Additional functions | | | | | | | | | | |
| Empty section | L _{min} | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | |
| | L _{max} | 29.86 | 44.26 | 44.26 | 44.26 | 44.26 | 44.26 | 44.26 | 44.26 | |
| Mixing box | L | 29.86 | 44.26 | 44.26 | 44.26 | 44.26 | 44.26 | 44.26 | 44.26 | |

* Include Droplet Eliminator after Cooling Coil

DIMENSIONS - AVS 65-380 - SUPPLY & EXHAUST

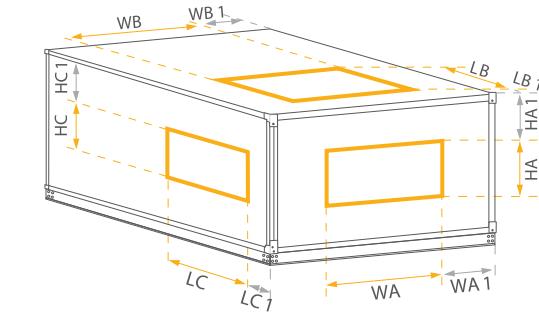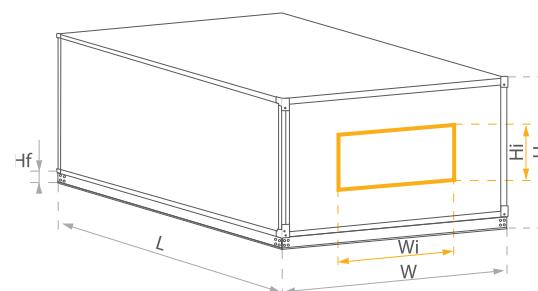

AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | |
|---------------|--------|-------|------|
| UNIT | WA | HA | WA1 |
| AVS 065 | 68.94 | 32.76 | 3.15 |
| AVS 085 | 76.57 | 36.73 | 3.15 |
| AVS 100 | 76.57 | 44.76 | 3.15 |
| AVS 130 | 92.64 | 44.76 | 3.15 |
| AVS 170 | 96.26 | 56.54 | 3.15 |
| AVS 230 | 115.94 | 65.71 | 3.15 |
| AVS 300 | 135.63 | 65.71 | 3.15 |
| AVS 380 | 140.04 | 84.49 | 3.15 |

| Top (US) | | | |
|----------|--------|-------|-------|
| UNIT | WB | LB | WB1 |
| AVS 065 | 47.20 | 22.64 | 14.02 |
| AVS 085 | 59.84 | 31.30 | 11.52 |
| AVS 100 | 59.84 | 31.30 | 11.52 |
| AVS 130 | 76.57 | 36.73 | 11.18 |
| AVS 170 | 76.57 | 36.73 | 12.99 |
| AVS 230 | 104.33 | 36.73 | 8.96 |
| AVS 300 | 124.02 | 36.73 | 8.96 |
| AVS 380 | 127.95 | 36.73 | 9.19 |


| END (FS) | | | |
|----------|--------|-------|-------|
| UNIT | WA | HA | WA1 |
| AVS 065 | 47.20 | 22.64 | 14.02 |
| AVS 085 | 59.84 | 31.30 | 11.52 |
| AVS 100 | 59.84 | 31.30 | 11.52 |
| AVS 130 | 76.57 | 36.73 | 11.18 |
| AVS 170 | 76.57 | 36.73 | 12.99 |
| AVS 230 | 104.33 | 36.73 | 8.96 |
| AVS 300 | 124.02 | 36.73 | 8.96 |
| AVS 380 | 127.95 | 36.73 | 9.19 |

| Top (US) | | | |
|----------|--------|-------|-------|
| UNIT | WB | LB | WB1 |
| AVS 065 | 59.84 | 31.30 | 7.70 |
| AVS 085 | 59.84 | 31.30 | 11.52 |
| AVS 100 | 59.84 | 31.30 | 11.52 |
| AVS 130 | 75.31 | 29.13 | 11.81 |
| AVS 170 | 76.57 | 36.73 | 12.99 |
| AVS 230 | 104.33 | 36.73 | 8.96 |
| AVS 300 | 124.02 | 36.73 | 8.96 |
| AVS 380 | 127.95 | 36.73 | 9.19 |

| Side (BS) | | | |
|-----------|-------|-------|------|
| UNIT | HC | LC | HC1 |
| AVS 065 | 24.13 | 14.96 | 6.89 |
| AVS 085 | 28.07 | 29.13 | 6.89 |
| AVS 100 | 35.94 | 29.13 | 6.89 |
| AVS 130 | 35.94 | 29.13 | 6.89 |
| AVS 170 | 47.76 | 29.13 | 6.89 |
| AVS 230 | 59.57 | 29.13 | 6.89 |
| AVS 300 | 59.57 | 29.13 | 6.89 |
| AVS 380 | 75.31 | 29.13 | 6.89 |

UNIT CODING

AVS 8-55 - CROSS-FLOW PLATE

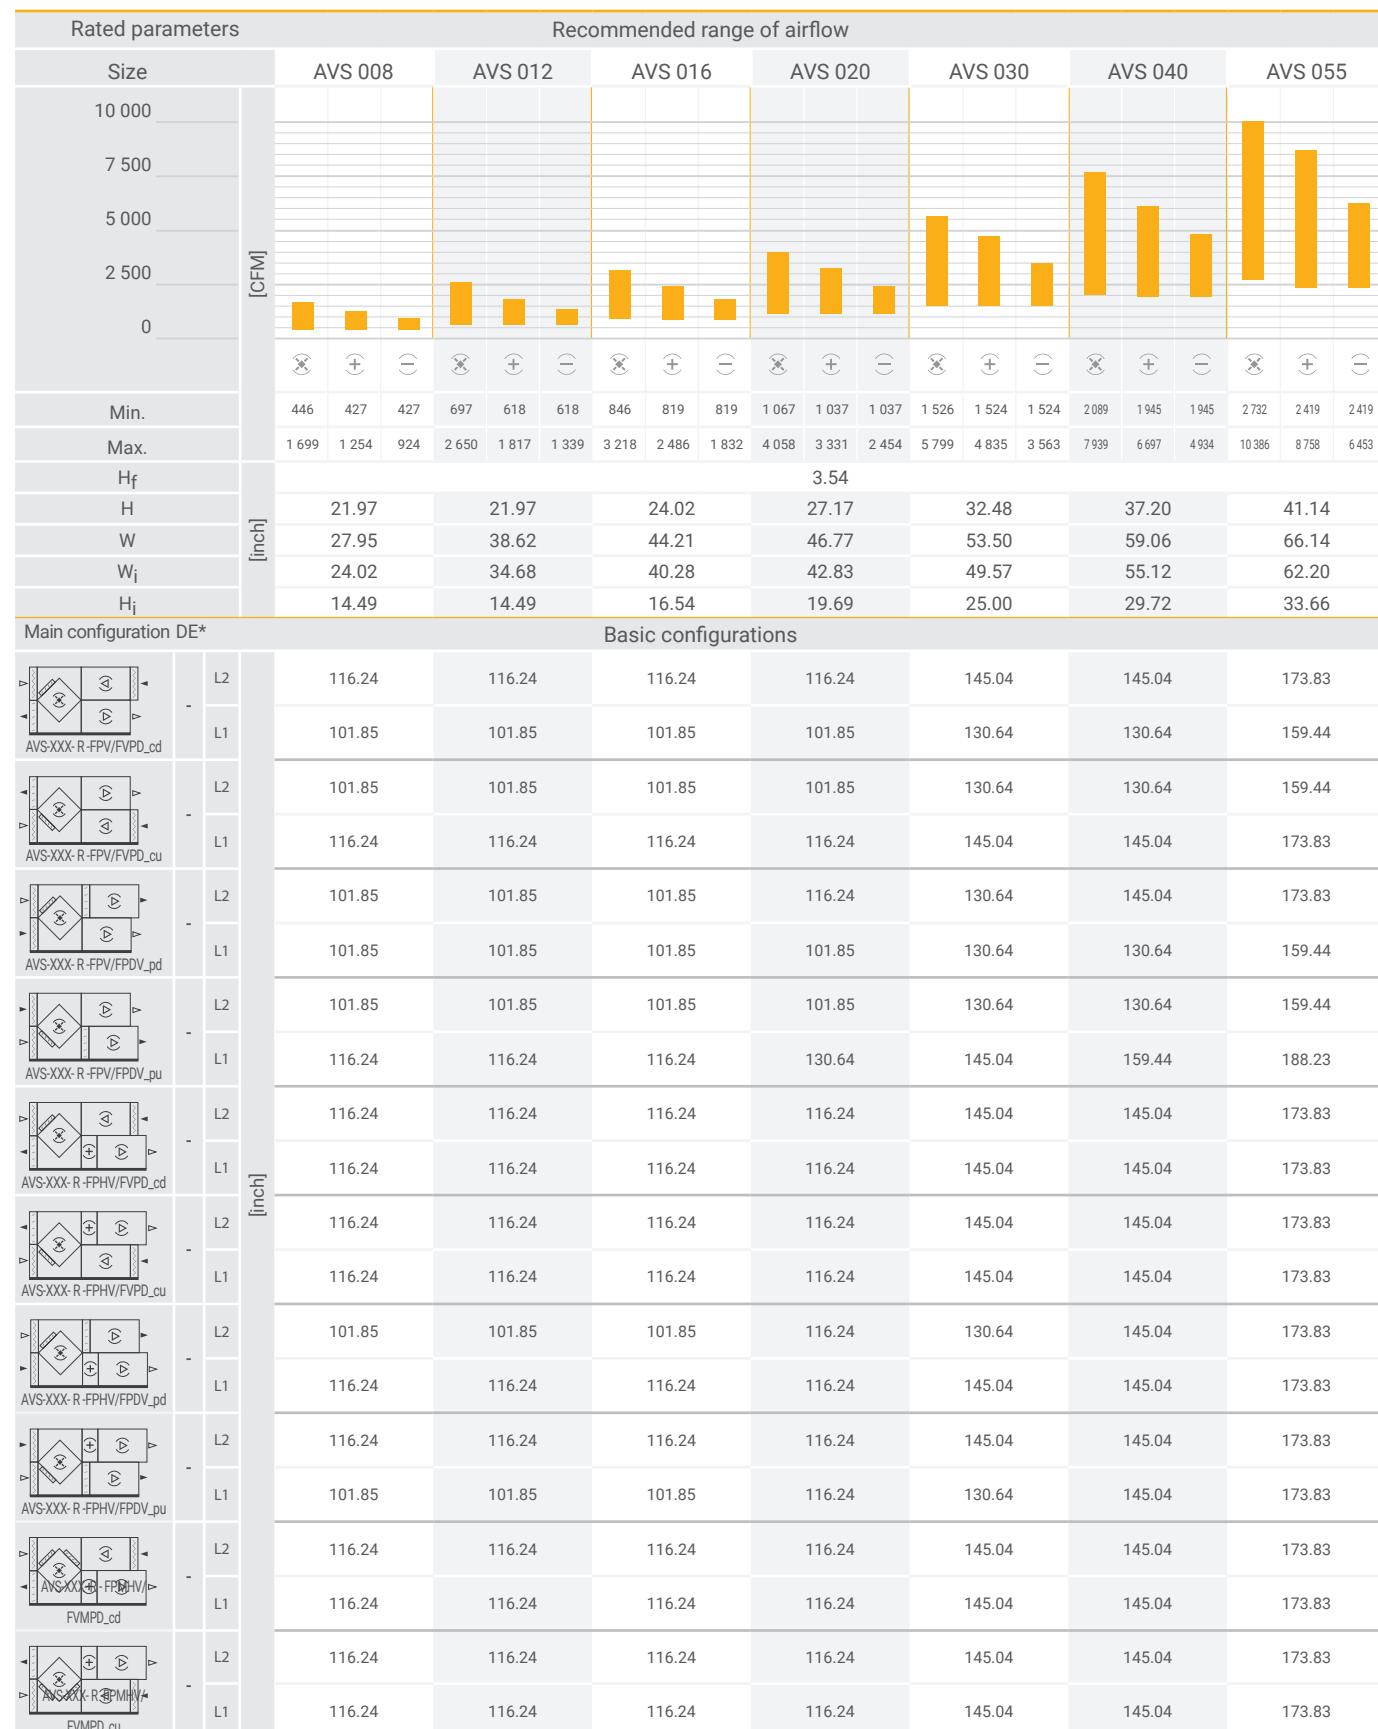

* Include Droplet Eliminator after Cooling Coil


L1- doesn't cover empty space in bottom deck

| Main configuration DE* | | Basic configurations | | | | | | | | | | | | | | | | | | | |
|---|------------------------|----------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
|  | AVS-XXX-R-FPCV/FVPD_cd | L2 | L1 | L2 | L1 | L2 | L1 | L2 | L1 | L2 | L1 | L2 | L1 | L2 | L1 | L2 | L1 | L2 | L1 | L2 | L1 |
|  | AVS-XXX-R-FPCV/FVPD_cu | 116.24 | 116.24 | 116.24 | 116.24 | 130.64 | 130.64 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 | 116.24 | 116.24 |
|  | AVS-XXX-R-FPCV/FPDV_pd | 116.24 | 116.24 | 116.24 | 116.24 | 130.64 | 130.64 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 | 116.24 | 116.24 |
|  | AVS-XXX-R-FPCV/FPDV_pu | 101.85 | 101.85 | 101.85 | 101.85 | 130.64 | 130.64 | 101. | | | | | | | | | | | | | |



* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck

| Main configuration DE* | | Basic configurations | | | | | | |
|--|---|----------------------|--------|--------|--------|--------|--------|--------|
| | | L2 | | | | | | |
|  FVMPD_d | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 130.64 | 130.64 | 130.64 | 130.64 | 159.44 | 159.44 |
| | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 145.04 | 145.04 | 145.04 | 145.04 | 159.44 | 159.44 |
|  FVMPD_cu | - | L1 | 130.64 | 130.64 | 130.64 | 130.64 | 159.44 | 159.44 |
| | - | L2 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L1 | 145.04 | 145.04 | 145.04 | 145.04 | 159.44 | 159.44 |
| | - | L2 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
|  AVS-XXX-R-FPHCVH/FVPD_cu | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 145.04 | 145.04 | 145.04 | 145.04 | 173.83 | 173.83 |
| | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 159.44 | 159.44 | 159.44 | 159.44 | 173.83 | 173.83 |
|  FVMPD_cu | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 145.04 | 145.04 | 145.04 | 145.04 | 173.83 | 173.83 |
| | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 159.44 | 159.44 | 159.44 | 159.44 | 173.83 | 173.83 |
|  AVS-XXX-R-FPHCVH/FPDV_pd | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 145.04 | 145.04 | 145.04 | 145.04 | 173.83 | 173.83 |
| | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 159.44 | 159.44 | 159.44 | 159.44 | 173.83 | 173.83 |
|  AVS-XXX-R-FPHCVH/FPDV_pv | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 145.04 | 145.04 | 145.04 | 145.04 | 173.83 | 173.83 |
| | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 159.44 | 159.44 | 159.44 | 159.44 | 173.83 | 173.83 |
|  AVS-XXX-R-FPHCVH/FVPD_cd | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 145.04 | 145.04 | 145.04 | 145.04 | 173.83 | 173.83 |
| | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 159.44 | 159.44 | 159.44 | 159.44 | 173.83 | 173.83 |
|  AVS-XXX-R-FPHCVH/FVPD_cu | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 145.04 | 145.04 | 145.04 | 145.04 | 173.83 | 173.83 |
| | - | L1 | 116.24 | 116.24 | 116.24 | 116.24 | 145.04 | 145.04 |
| | - | L2 | 159.44 | 159.44 | 159.44 | 159.44 | 173.83 | 173.83 |

* Include Droplet Eliminator after Cooling Coil

L-1- doesn't cover empty space in bottom deck

AVS 65-380 - CROSS-FLOW PLATE

| Rated parameters | | Recommended range of airflow | | | | | | | |
|------------------|--------------------------|------------------------------|--------|--------|--------|--------|--------|--------|--------|
| Size | | AVS065 | AVS085 | AVS100 | AVS130 | AVS170 | AVS230 | AVS300 | AVS380 |
| [CFM] | 60 000 | | | | | | | | |
| | 45 000 | | | | | | | | |
| | 30 000 | | | | | | | | |
| | 15 000 | | | | | | | | |
| | 0 | | | | | | | | |
| | Min. | 3 307 | 3 307 | 4 185 | 4 069 | 4 069 | 4 501 | 4 501 | 5 070 |
| | | 11 972 | 10 640 | 7 840 | 15 905 | 13 199 | 9 725 | 15 905 | 16 026 |
| | Max. | 11 972 | 10 640 | 7 840 | 15 905 | 13 199 | 9 725 | 15 905 | 16 026 |
| | H _{fd} | 3.54 | | 3.15 | | | | | |
| | H _{fu} | 0.00 | 0.00 | 2.36 | 2.36 | 2.36 | 2.36 | 2.36 | 2.36 |
| [inch] | H | 42.6 | 46.57 | 54.21 | 54.21 | 65.98 | 75.16 | 75.16 | 93.94 |
| | W | 75.24 | 82.87 | 82.87 | 98.94 | 102.56 | 122.24 | 141.93 | 146.34 |
| | W _i | 71.3 | 78.94 | 78.94 | 95.00 | 98.62 | 118.31 | 137.99 | 142.40 |
| | H _j | 35.12 | 39.09 | 47.13 | 47.13 | 58.90 | 68.07 | 68.07 | 86.85 |
| | Main configuration DE* | Basic configurations | | | | | | | |
| [inch] | AVS-XXX-R-FPV/FVPD_cd | L2 | 173.83 | 188.23 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 159.44 | 173.83 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| | AVS-XXX-R-FPV/FVPD_cu | L2 | 159.44 | 173.83 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| | | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | AVS-XXX-R-FPV/FPDV_pd | L2 | 173.83 | 173.83 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| | | L1 | 159.44 | 173.83 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| | AVS-XXX-R-FPV/FPDV_pu | L2 | 159.44 | 173.83 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| | | L1 | 188.23 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | AVS-XXX-R-FPHV/FVPD_cd | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| [inch] | AVS-XXX-R-FPHV/FVPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | AVS-XXX-R-FPHV/FPDV_pd | L2 | 173.83 | 173.83 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| | | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | AVS-XXX-R-FPHV/FPDV_pu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | | L1 | 173.83 | 188.23 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| | AVS-XXX-R-FPMHV/FVMPD_cd | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | AVS-XXX-R-FPMHV/FVMPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |

* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck

| Main configuration DE* | | Basic configurations | | | | | | |
|--------------------------|----|----------------------|--------|--------|--------|--------|--------|--------|
| AVS-XXX-R-FPCV/FVPD_cd | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 |
| | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| AVS-XXX-R-FPCV/FVPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| AVS-XXX-R-FPCV/FPDV_pd | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | L1 | 173.83 | 173.83 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| AVS-XXX-R-FPCV/FPDV_pu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | L1 | 173.83 | 173.83 | 159.44 | 159.44 | 202.63 | 202.63 | 217.03 |
| AVS-XXX-R-FPMCV/FVMPD_cd | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 |
| | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| AVS-XXX-R-FPMCV/FVMPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| AVS-XXX-R-FPCVH/FVPD_cd | L2 | 188.23 | 202.63 | 188.23 | 188.23 | 231.42 | 231.42 | 245.82 |
| | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| AVS-XXX-R-FPCVH/FVPD_cu | L2 | 188.23 | 202.63 | 188.23 | 188.23 | 231.42 | 231.42 | 245.82 |
| | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| AVS-XXX-R-FPCVH/FVMPD_cd | L2 | 188.23 | 202.63 | 188.23 | 188.23 | 231.42 | 231.42 | 245.82 |
| | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |
| AVS-XXX-R-FPCVH/FVMPD_cu | L2 | 188.23 | 202.63 | 188.23 | 188.23 | 231.42 | 231.42 | 245.82 |
| | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 231.42 |

* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck



* Include Droplet Eliminator after Cooling Coil



L1- doesn't cover empty space in bottom deck

| Main configuration DE* | | Basic configurations | | | | | | | | |
|------------------------|--------------------------|----------------------|--------|--------|--------|--------|--------|--------|--------|--------|
| [inch] | FVMPD_cd | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 188.23 | 202.63 | 188.23 | 188.23 | 231.42 | 231.42 | 231.42 | 245.82 |
| [inch] | FVMPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 188.23 | 202.63 | 188.23 | 188.23 | 231.42 | 231.42 | 231.42 | 245.82 |
| [inch] | AVS-XXX-R-FPHCVH/FVPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |
| [inch] | FVMPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |
| [inch] | AVS-XXX-R-FPHCVH/FPDV_pd | L2 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |
| | | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| [inch] | AVS-XXX-R-FPHCVH/FPDV_pu | L2 | 188.23 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |
| [inch] | AVS-XXX-R-FPHCVH/FVPD_cd | L2 | 188.23 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |
| [inch] | AVS-XXX-R-FPHCVH/FVPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |
| [inch] | AVS-XXX-R-FPHCVH/FVPD_cd | L2 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |
| | | L1 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| [inch] | AVS-XXX-R-FPHCVH/FVPD_cu | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |
| [inch] | AVS-XXX-R-FPHCVH/FVPD_cd | L2 | 173.83 | 188.23 | 173.83 | 173.83 | 217.03 | 217.03 | 217.03 | 231.42 |
| | | L1 | 202.63 | 217.03 | 202.63 | 202.63 | 245.82 | 245.82 | 245.82 | 260.22 |

* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck

DIMENSIONS - AVS 8-55 - CROSS-FLOW PLATE

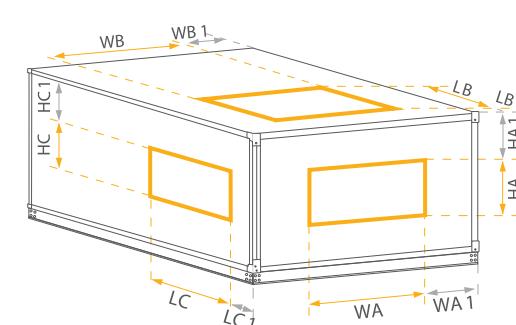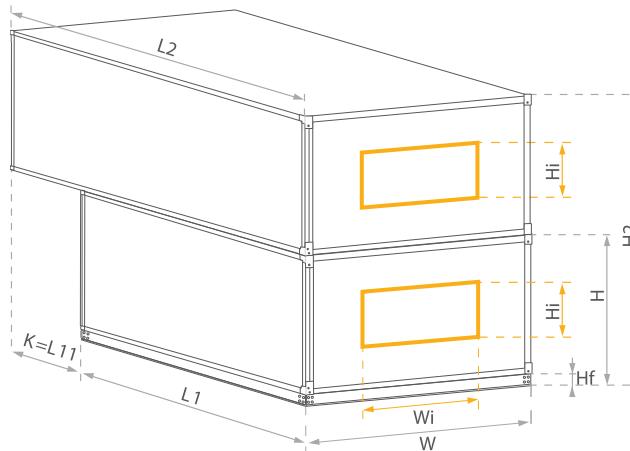

AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | | |
|---------------|-------|-------|------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 008 | 21.65 | 12.13 | 3.15 | 3.15 |
| AVS 012 | 32.32 | 12.13 | 3.15 | 3.15 |
| AVS 016 | 37.91 | 14.17 | 3.15 | 3.15 |
| AVS 020 | 40.47 | 17.32 | 3.15 | 3.15 |
| AVS 030 | 47.20 | 22.64 | 3.15 | 3.15 |
| AVS 040 | 52.76 | 27.36 | 3.15 | 3.15 |
| AVS 055 | 59.84 | 31.30 | 3.15 | 3.15 |

| END (FS) | | | | |
|----------|-------|-------|-------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 008 | 17.97 | 7.97 | 5.00 | 5.24 |
| AVS 012 | 25.97 | 7.97 | 6.34 | 5.24 |
| AVS 016 | 33.97 | 7.97 | 5.16 | 6.26 |
| AVS 020 | 25.97 | 11.97 | 10.43 | 5.83 |
| AVS 030 | 33.97 | 11.97 | 9.80 | 8.50 |
| AVS 040 | 40.51 | 17.36 | 9.29 | 8.19 |
| AVS 055 | 47.24 | 22.68 | 9.47 | 7.48 |



| Side (BS) | | | | |
|-----------|-------|-------|------|------|
| UNIT | HC | LC | HC1 | LC1 |
| AVS 008 | 10.94 | 7.94 | 4.33 | 3.74 |
| AVS 012 | 10.94 | 7.94 | 4.33 | 3.74 |
| AVS 016 | 12.94 | 7.94 | 4.33 | 3.74 |
| AVS 020 | 15.94 | 11.94 | 4.33 | 3.82 |
| AVS 030 | 20.94 | 11.94 | 4.33 | 3.98 |
| AVS 040 | 16.26 | 14.96 | 6.89 | 8.70 |
| AVS 055 | 24.13 | 14.96 | 6.89 | 6.73 |

UNIT CODING

AVS - XX

AVS - type of AHU family
XXX - size of unit (equal to the rated air flow in cfm*0.001)
R/L - inspection side (R-right, L-left)
PHC - symbols of main thermodynamic functions (basic functions)
Length depends on AHU equipment

DIMENSIONS - AVS 65-380 - CROSS-FLOW PLATE

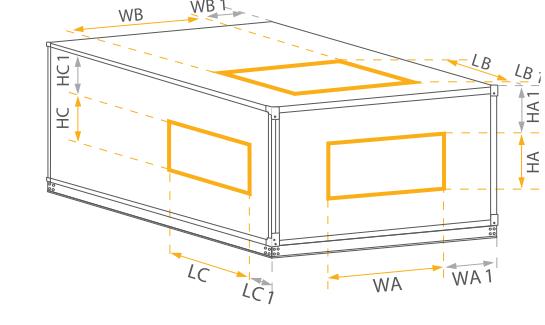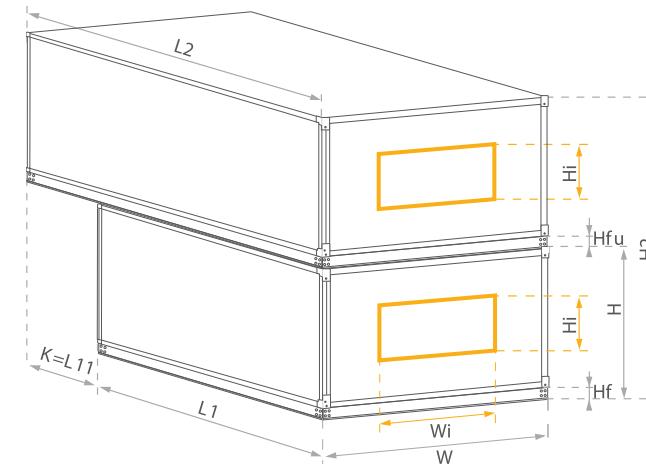

AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | | |
|---------------|--------|-------|------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 065 | 68.94 | 32.76 | 3.15 | 3.15 |
| AVS 085 | 76.57 | 36.73 | 3.15 | 3.15 |
| AVS 100 | 76.57 | 44.76 | 3.15 | 3.15 |
| AVS 130 | 92.64 | 44.76 | 3.15 | 3.15 |
| AVS 170 | 96.26 | 56.54 | 3.15 | 3.15 |
| AVS 230 | 115.94 | 65.71 | 3.15 | 3.15 |
| AVS 300 | 135.63 | 65.71 | 3.15 | 3.15 |
| AVS 300 | 140.04 | 84.49 | 3.15 | 3.15 |

| END (FS) | | | | |
|----------|--------|-------|-------|-------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 065 | 47.24 | 22.68 | 14.02 | 8.23 |
| AVS 085 | 59.88 | 31.34 | 11.52 | 5.87 |
| AVS 100 | 59.88 | 31.34 | 11.52 | 9.88 |
| AVS 130 | 76.61 | 36.77 | 11.18 | 7.17 |
| AVS 170 | 76.61 | 36.77 | 12.99 | 13.07 |
| AVS 230 | 104.37 | 36.77 | 8.96 | 17.64 |
| AVS 300 | 124.06 | 36.77 | 8.96 | 17.64 |
| AVS 380 | 127.99 | 36.77 | 9.19 | 27.05 |

| Side (BS) | | | | |
|-----------|-------|-------|------|------|
| UNIT | HC | LC | HC1 | LC1 |
| AVS 065 | 24.13 | 14.96 | 6.89 | 7.46 |
| AVS 085 | 28.07 | 29.13 | 6.89 | 7.48 |
| AVS 100 | 35.94 | 29.13 | 6.89 | 7.56 |
| AVS 130 | 35.94 | 29.13 | 6.89 | 7.56 |
| AVS 170 | 47.76 | 29.13 | 6.89 | 7.54 |
| AVS 230 | 59.57 | 29.13 | 6.89 | 6.22 |
| AVS 300 | 59.57 | 29.13 | 6.89 | 6.22 |
| AVS 380 | 75.31 | 29.13 | 6.89 | 7.74 |

UNIT CODING

AVS - XX

AVS - type of AHU family
XXX - size of unit (equal to the rated air flow in cfm*0.001)
R/L - inspection side (R-right, L-left)
PHC - symbols of main thermodynamic functions (basic functions)
Length depends on AHU equipment

AVS 12 - 65 WITH ENERGY WHEEL

| Rated parameters | | Recommended range of airflow | | | | | | | | | | | | | | | | | | | | |
|------------------|--------|------------------------------|-------|---------|-------|---------|-------|---------|------|---------|------|---------|------|---------|------|------|------|------|------|-------|-------|------|
| Size | | AVS 012 | | AVS 016 | | AVS 020 | | AVS 030 | | AVS 040 | | AVS 055 | | AVS 065 | | | | | | | | |
| 12 000 | [CFM] | 618 | 618 | 618 | 819 | 819 | 819 | 1037 | 1037 | 1037 | 1524 | 1524 | 1945 | 1945 | 2419 | 2419 | 2419 | 3307 | 3307 | 3307 | | |
| 8 000 | | 618 | 618 | 618 | 819 | 819 | 819 | 1037 | 1037 | 1037 | 1524 | 1524 | 1945 | 1945 | 2419 | 2419 | 2419 | 3307 | 3307 | 3307 | | |
| 4 000 | | 618 | 618 | 618 | 819 | 819 | 819 | 1037 | 1037 | 1037 | 1524 | 1524 | 1945 | 1945 | 2419 | 2419 | 2419 | 3307 | 3307 | 3307 | | |
| 0 | | 618 | 618 | 618 | 819 | 819 | 819 | 1037 | 1037 | 1037 | 1524 | 1524 | 1945 | 1945 | 2419 | 2419 | 2419 | 3307 | 3307 | 3307 | | |
| Min. | | 618 | 618 | 618 | 819 | 819 | 819 | 1037 | 1037 | 1037 | 1524 | 1524 | 1945 | 1945 | 2419 | 2419 | 2419 | 3307 | 3307 | 3307 | | |
| Max. | | 2179 | 1817 | 1339 | 2664 | 2486 | 1832 | 4068 | 3331 | 2454 | 5869 | 4835 | 3563 | 7364 | 6697 | 4934 | 9536 | 8758 | 6453 | 12205 | 10640 | 7840 |
| H _f | | | | | | | | | | | | | | | | | | | | | | |
| H | [inch] | 21.97 | 24.02 | 27.17 | 32.48 | 37.20 | 41.14 | 42.60 | | | | | | | | | | | | | | |
| W | | 38.62 | 44.21 | 46.77 | 53.50 | 59.06 | 66.14 | 75.24 | | | | | | | | | | | | | | |
| W _i | | 34.68 | 40.28 | 42.83 | 49.57 | 55.12 | 62.20 | 71.30 | | | | | | | | | | | | | | |
| H _i | | 14.49 | 16.54 | 19.69 | 25.00 | 29.72 | 33.66 | 35.12 | | | | | | | | | | | | | | |
| H ₂ | | 40.39 | 44.49 | 50.79 | 61.42 | 70.87 | 78.74 | 81.65 | | | | | | | | | | | | | | |

| Main configuration DE* | | Basic configurations | | | | | | | | | | | | | | |
|-------------------------|-----|----------------------|--------|--------|--------|--------|--------|--------|--|--------|--|--------|--|--------|--|--|
| [inch] | | [inch] | | [inch] | | [inch] | | [inch] | | [inch] | | [inch] | | [inch] | | |
| AVS-XXX-R-FRV/FRV_cd | L2 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRV/FRV_cu | L11 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRHV/FRV_cd | L2 | 28.80 | 28.80 | 28.80 | 43.19 | 43.19 | 57.59 | 57.59 | | | | | | | | |
| AVS-XXX-R-FRHV/FRV_cu | L11 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRHV/FRV_cd | L2 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRHV/FRV_cu | L11 | 101.85 | 101.85 | 101.85 | 116.24 | 116.24 | 130.64 | 130.64 | | | | | | | | |
| AVS-XXX-R-FRHV/FRV_cu | L2 | 28.80 | 28.80 | 28.80 | 43.19 | 43.19 | 57.59 | 57.59 | | | | | | | | |
| AVS-XXX-R-FRHV/FRV_cd | L11 | 101.85 | 101.85 | 101.85 | 116.24 | 116.24 | 130.64 | 130.64 | | | | | | | | |
| AVS-XXX-R-FRHV/FRV_cu | L2 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRHV/FRV_cd | L11 | 43.19 | 43.19 | 43.19 | 57.59 | 57.59 | 71.99 | 71.99 | | | | | | | | |
| AVS-XXX-R-FRMHV/FVMR_cd | L2 | 116.24 | 116.24 | 116.24 | 130.64 | 130.64 | 145.04 | 145.04 | | | | | | | | |
| AVS-XXX-R-FRMHV/FVMR_cu | L1 | 130.64 | 130.64 | 130.64 | 145.04 | 145.04 | 159.44 | 159.44 | | | | | | | | |
| AVS-XXX-R-FRMHV/FVMR_cu | L2 | 130.64 | 130.64 | 130.64 | 145.04 | 145.04 | 159.44 | 159.44 | | | | | | | | |
| AVS-XXX-R-FRCV/FRV_cd | L11 | 116.24 | 116.24 | 116.24 | 130.64 | 130.64 | 145.04 | 145.04 | | | | | | | | |
| AVS-XXX-R-FRCV/FRV_cu | L2 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRCV/FRV_cd | L11 | 101.85 | 101.85 | 101.85 | 116.24 | 116.24 | 130.64 | 130.64 | | | | | | | | |
| AVS-XXX-R-FRCV/FRV_cu | L2 | 28.80 | 28.80 | 28.80 | 43.19 | 43.19 | 57.59 | 57.59 | | | | | | | | |
| AVS-XXX-R-FRCV/FRV_cd | L11 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRCV/FRV_cu | L2 | 116.24 | 116.24 | 116.24 | 130.64 | 130.64 | 145.04 | 145.04 | | | | | | | | |
| AVS-XXX-R-FRCV/FRV_cu | L11 | 28.80 | 28.80 | 28.80 | 43.19 | 43.19 | 57.59 | 57.59 | | | | | | | | |
| AVS-XXX-R-FRCVH/FVMR_cd | L2 | 101.85 | 101.85 | 101.85 | 116.24 | 116.24 | 130.64 | 130.64 | | | | | | | | |
| AVS-XXX-R-FRCVH/FVMR_cu | L1 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRCVH/FVMR_cu | L2 | 101.85 | 101.85 | 101.85 | 116.24 | 116.24 | 130.64 | 130.64 | | | | | | | | |
| AVS-XXX-R-FRCVH/FVMR_cd | L11 | 43.19 | 43.19 | 43.19 | 57.59 | 57.59 | 71.99 | 71.99 | | | | | | | | |
| AVS-XXX-R-FRCVH/FVMR_cu | L2 | 101.85 | 101.85 | 101.85 | 116.24 | 116.24 | 130.64 | 130.64 | | | | | | | | |
| AVS-XXX-R-FRCVH/FVMR_cu | L11 | 87.45 | 87.45 | 87.45 | 101.85 | 101.85 | 116.24 | 116.24 | | | | | | | | |
| AVS-XXX-R-FRCVH/FVMR_cu | L2 | 43.19 | 43.19 | 43.19 | 57.59 | 57.59 | 71.99 | 71.99 | | | | | | | | |

* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck

| Main configuration DE* | | Basic configurations | | | | | | | | | | | | | |
|------------------------|--|----------------------|--|--|--|--|--|--|--|--|--|--|--|--|--|
| [inch] | | | | | | | | | | | | | | | |


AVS 85-380 WITH ENERGY WHEEL

| Rated parameters | | Recommended range of airflow | | | | | | | | | | | | | | | | | | | | |
|------------------|-------|------------------------------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|--------|
| Size | | AVS085 | | AVS100 | | AVS130 | | AVS170 | | AVS230 | | AVS300 | | AVS380 | | | | | | | | |
| 60 000 | | | | | | | | | | | | | | | | | | | | | | |
| 40 000 | | | | | | | | | | | | | | | | | | | | | | |
| 20 000 | | | | | | | | | | | | | | | | | | | | | | |
| 0 | | | | | | | | | | | | | | | | | | | | | | |
| | [CFM] | | | | | | | | | | | | | | | | | | | | | |
| | | ⊖ | ⊕ | ⊖ | ⊖ | ⊕ | ⊖ | ⊖ | ⊕ | ⊖ | ⊖ | ⊕ | ⊖ | ⊖ | ⊕ | | | | | | | |
| Min. | | 4 069 | 4 069 | 4 501 | 4 501 | 4 501 | 4 979 | 5 183 | 5 183 | 7 630 | 7 630 | 7 630 | 10 427 | 10 427 | 12 165 | 12 165 | | | | | | |
| Max. | | 15 121 | 13 198 | 9 724 | 15 122 | 16 026 | 11 809 | 21 698 | 19 697 | 14 513 | 23 578 | 26 348 | 19 414 | 32 704 | 35 609 | 26 238 | 45 678 | 43 761 | 32 245 | 48 968 | 58 255 | 42 924 |
| H _{fd} | | 3.54 | | 3.15 | | | | | | | | | | | | | | | | | | |
| H _{fu} | | 0.00 | | 2.36 | | 2.36 | | 2.36 | | 2.36 | | 2.36 | | 2.36 | | 2.36 | | | | | | |
| H | | 46.57 | | 54.21 | | 54.21 | | 65.98 | | 75.16 | | 75.16 | | 93.94 | | | | | | | | |
| W | | 82.87 | | 82.87 | | 98.94 | | 102.56 | | 122.24 | | 141.93 | | 146.34 | | | | | | | | |
| W _i | | 78.94 | | 78.94 | | 95.00 | | 98.62 | | 118.31 | | 137.99 | | 142.4 | | | | | | | | |
| H _i | | 39.09 | | 47.13 | | 47.13 | | 58.9 | | 68.07 | | 68.07 | | 86.85 | | | | | | | | |
| H ₂ | | 89.61 | | 107.64 | | 107.64 | | 131.18 | | 149.53 | | 149.53 | | 187.09 | | | | | | | | |

| Main configuration DE* | | Basic configurations | | | | | | | |
|------------------------|--|----------------------|--------|--------|--------|--------|--------|--------|--------|
| | | L2 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | - L1 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | L11 | 57.59 | 43.19 | 43.19 | 57.59 | 57.59 | 57.59 | 57.59 |
| | | L2 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | - L1 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | L11 | 57.59 | 43.19 | 43.19 | 57.59 | 57.59 | 57.59 | 57.59 |
| | | L2 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | - L1 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 |
| | | L11 | 57.59 | 43.19 | 43.19 | 57.59 | 57.59 | 57.59 | 57.59 |
| | | L2 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 |
| | | - L1 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | L11 | 71.99 | 57.59 | 57.59 | 71.99 | 71.99 | 71.99 | 71.99 |
| | | L2 | 159.44 | 145.04 | 145.04 | 159.44 | 159.44 | 159.44 | 159.44 |
| | | - L1 | 173.83 | 159.44 | 159.44 | 173.83 | 173.83 | 173.83 | 173.83 |
| | | L2 | 173.83 | 159.44 | 159.44 | 173.83 | 173.83 | 173.83 | 173.83 |
| | | - L1 | 159.44 | 145.04 | 145.04 | 159.44 | 159.44 | 159.44 | 159.44 |
| | | L2 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | - L1 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 |
| | | L11 | 57.59 | 43.19 | 43.19 | 57.59 | 57.59 | 57.59 | 57.59 |
| | | L2 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | - L1 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 |
| | | L11 | 57.59 | 43.19 | 43.19 | 57.59 | 57.59 | 57.59 | 57.59 |
| | | L2 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 |
| | | - L1 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | L11 | 71.99 | 57.59 | 57.59 | 71.99 | 71.99 | 71.99 | 71.99 |
| | | L2 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 |
| | | - L1 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | L11 | 71.99 | 57.59 | 57.59 | 71.99 | 71.99 | 71.99 | 71.99 |
| | | L2 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 |
| | | - L1 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | L11 | 71.99 | 57.59 | 57.59 | 71.99 | 71.99 | 71.99 | 71.99 |
| | | L2 | 130.64 | 116.24 | 116.24 | 130.64 | 130.64 | 130.64 | 130.64 |
| | | - L1 | 116.24 | 101.85 | 101.85 | 116.24 | 116.24 | 116.24 | 116.24 |
| | | L11 | 71.99 | 57.59 | 57.59 | 71.99 | 71.99 | 71.99 | 71.99 |

* Include Droplet Eliminator after Cooling Coil

| 1- doesn't cover empty space in bottom deck

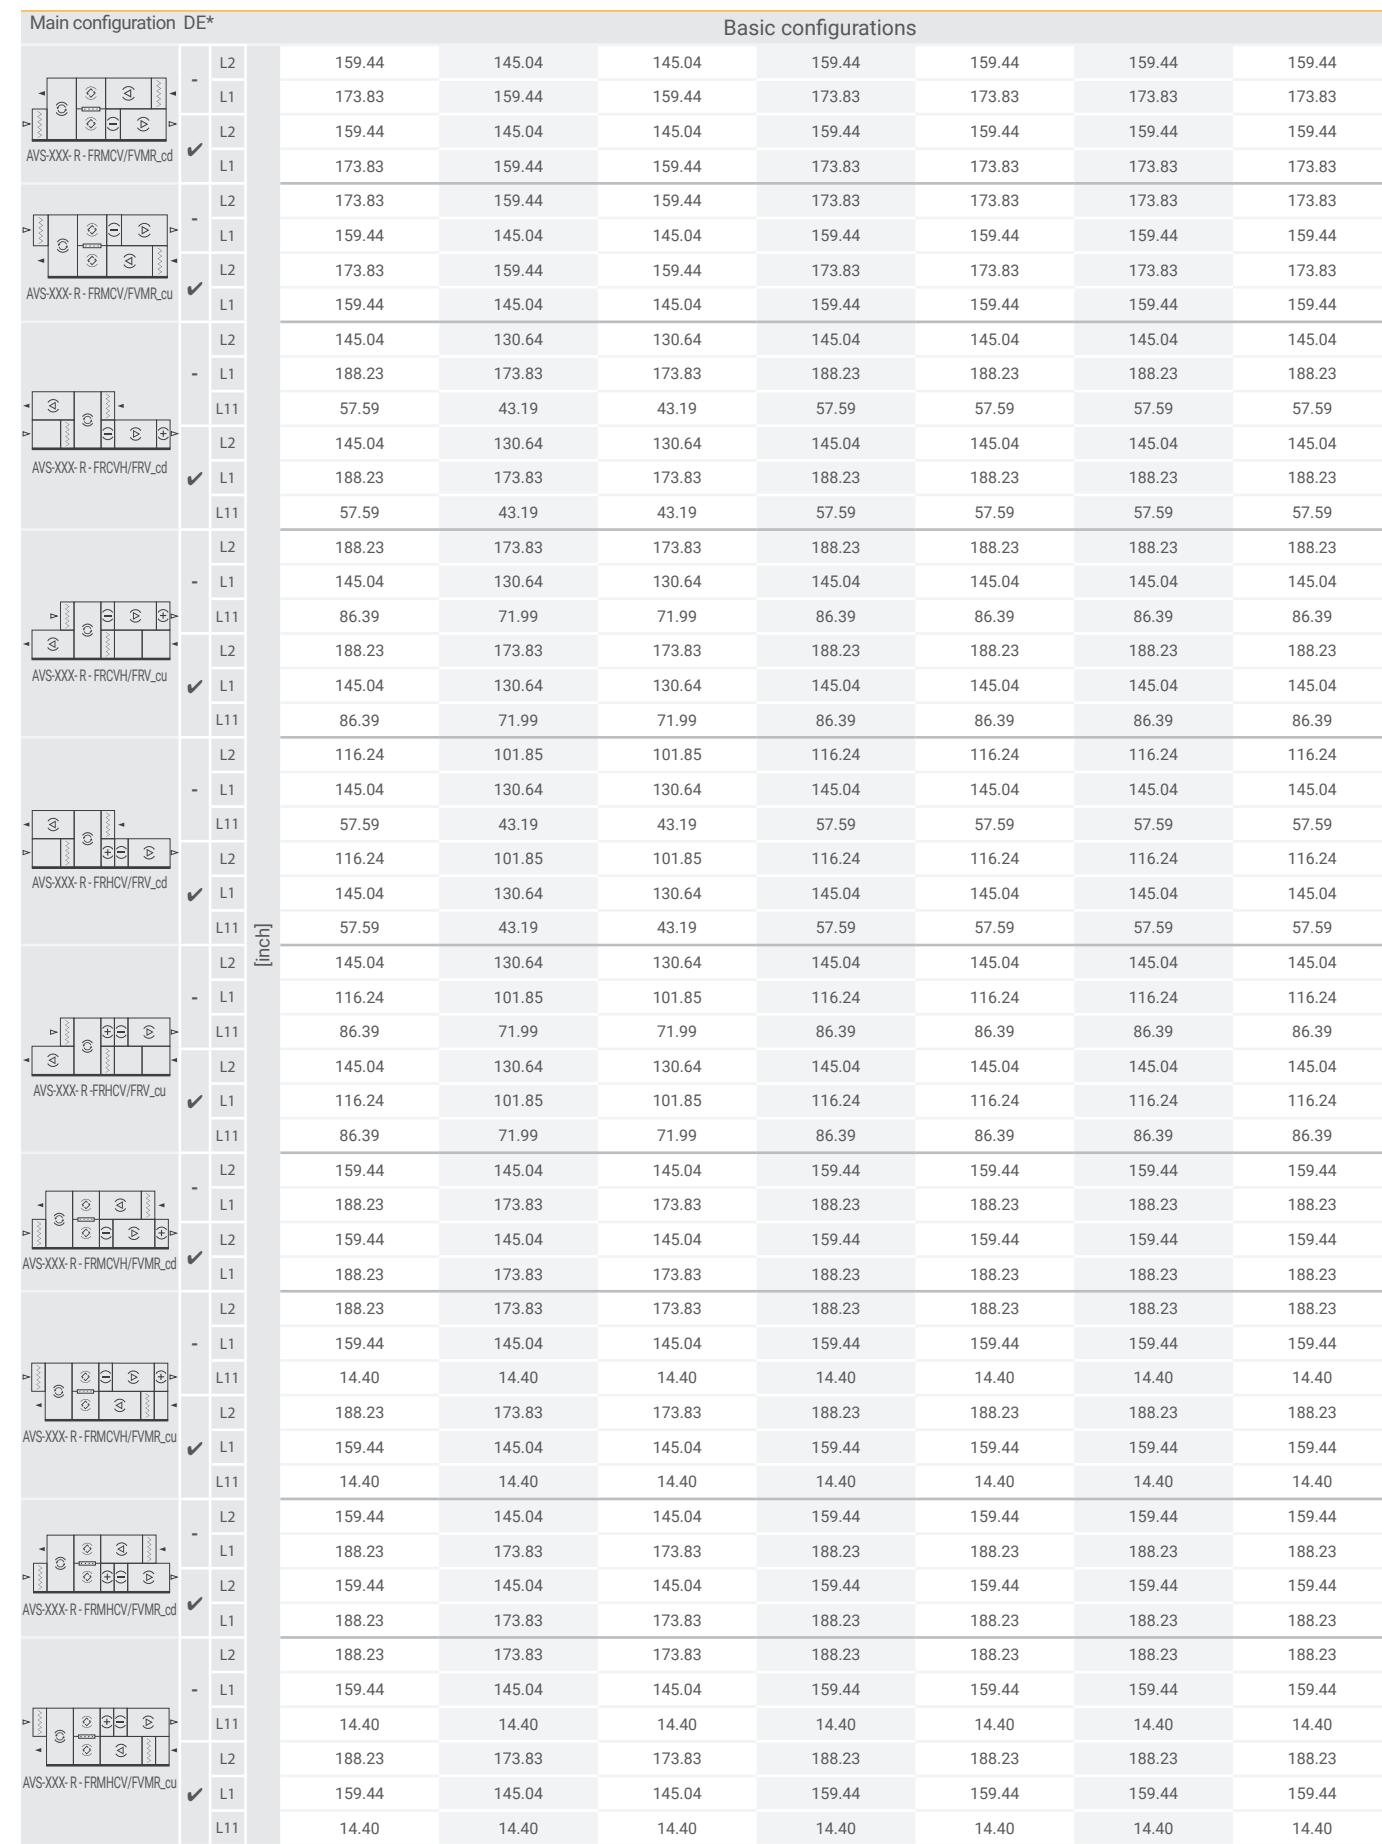


* Include Droplet Eliminator after Cooling Coil

| 1- doesn't cover empty space in bottom deck



DIMENSIONS -AVS 12 - 65 WITH ENERGY WHEEL

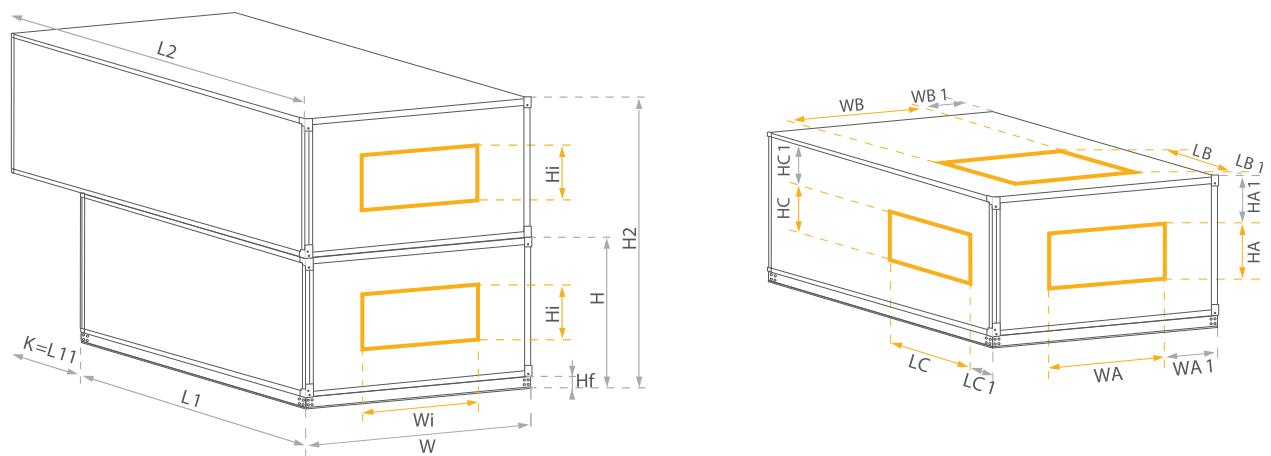


AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | | |
|---------------|-------|-------|------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 012 | 32.32 | 12.13 | 3.15 | 3.15 |
| AVS 016 | 37.91 | 14.17 | 3.15 | 3.15 |
| AVS 020 | 40.47 | 17.32 | 3.15 | 3.15 |
| AVS 030 | 47.20 | 22.64 | 3.15 | 3.15 |
| AVS 040 | 52.76 | 27.36 | 3.15 | 3.15 |
| AVS 055 | 59.84 | 31.30 | 3.15 | 3.15 |
| AVS 065 | 68.94 | 32.76 | 3.15 | 3.15 |

| END (FS) | | | | |
|----------|-------|-------|-------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 012 | 25.97 | 7.97 | 6.34 | 5.24 |
| AVS 016 | 33.97 | 7.97 | 5.16 | 6.26 |
| AVS 020 | 25.97 | 11.97 | 10.43 | 5.83 |
| AVS 030 | 33.97 | 11.97 | 9.80 | 8.50 |
| AVS 040 | 40.51 | 17.36 | 9.29 | 8.19 |
| AVS 055 | 47.24 | 22.68 | 9.47 | 7.48 |
| AVS 065 | 47.24 | 22.68 | 14.02 | 8.23 |

DIMENSIONS -AVS 85-380 WITH ENERGY WHEEL

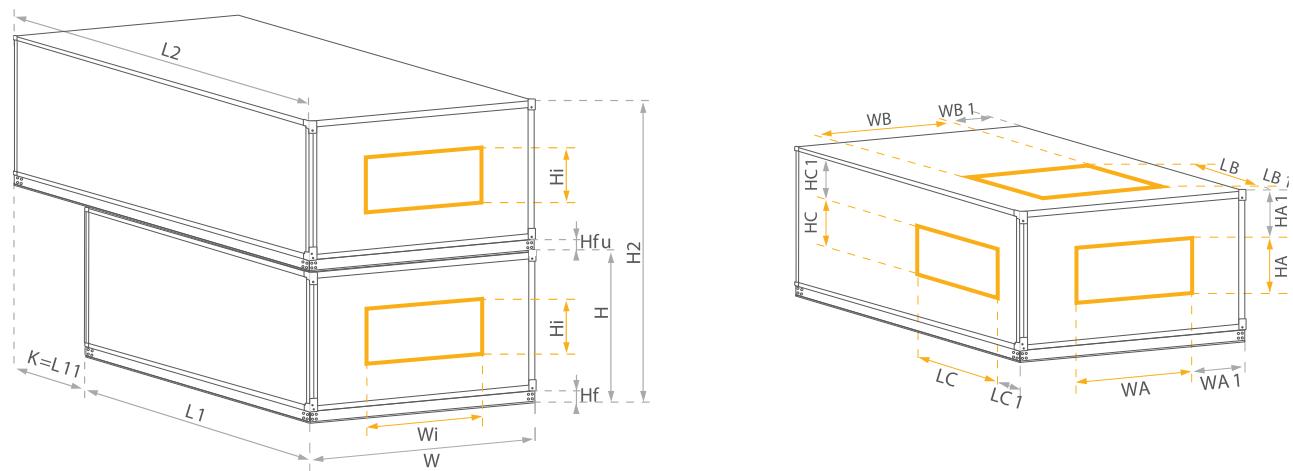

AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | | |
|---------------|--------|-------|------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 085 | 76.57 | 36.73 | 3.15 | 3.15 |
| AVS 100 | 76.57 | 44.76 | 3.15 | 3.15 |
| AVS 130 | 92.64 | 44.76 | 3.15 | 3.15 |
| AVS 170 | 96.26 | 56.54 | 3.15 | 3.15 |
| AVS 230 | 115.94 | 65.71 | 3.15 | 3.15 |
| AVS 300 | 135.63 | 65.71 | 3.15 | 3.15 |
| AVS 380 | 140.04 | 84.49 | 3.15 | 3.15 |

| END (FS) | | | | |
|----------|--------|-------|-------|-------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 085 | 59.88 | 31.34 | 11.52 | 5.87 |
| AVS 100 | 59.88 | 31.34 | 11.52 | 9.88 |
| AVS 130 | 76.61 | 36.77 | 11.18 | 7.17 |
| AVS 170 | 76.61 | 36.77 | 12.99 | 13.07 |
| AVS 230 | 104.37 | 36.77 | 8.96 | 17.64 |
| AVS 300 | 124.06 | 36.77 | 8.96 | 17.64 |
| AVS 380 | 127.99 | 36.77 | 9.19 | 27.05 |

| Side (BS) | | | | |
|-----------|-------|-------|------|------|
| UNIT | HC | LC | HC1 | LC1 |
| AVS 012 | 10.94 | 7.94 | 4.33 | 3.74 |
| AVS 016 | 12.94 | 7.94 | 4.33 | 3.74 |
| AVS 020 | 15.94 | 11.94 | 4.33 | 3.82 |
| AVS 030 | 20.94 | 11.94 | 4.33 | 3.98 |
| AVS 040 | 16.26 | 14.96 | 6.89 | 8.70 |
| AVS 055 | 24.13 | 14.96 | 6.89 | 6.73 |
| AVS 065 | 24.13 | 14.96 | 6.89 | 7.46 |

| Side (BS) | | | | |
|-----------|-------|-------|------|------|
| UNIT | HC | LC | HC1 | LC1 |
| AVS 085 | 28.07 | 29.13 | 6.89 | 7.48 |
| AVS 100 | 35.94 | 29.13 | 6.89 | 7.56 |
| AVS 130 | 35.94 | 29.13 | 6.89 | 7.56 |
| AVS 170 | 47.76 | 29.13 | 6.89 | 7.54 |
| AVS 230 | 59.57 | 29.13 | 6.89 | 6.22 |
| AVS 300 | 59.57 | 29.13 | 6.89 | 6.22 |
| AVS 380 | 75.31 | 29.13 | 6.89 | 7.74 |

UNIT CODING

AVS - XX

AVS - type of AHU family

XXX - size of unit (equal to the rated air flow in cfm*0.001)

R/L - inspection side (R-right, L-left)

PHC - symbols of main thermodynamic functions (basic functions)

Length depends on AHU equipment

UNIT CODING

AVS - XX

AVS - type of AHU family

XXX - size of unit (equal to the rated air flow in cfm*0.001)

R/L - inspection side (R-right, L-left)

PHC - symbols of main thermodynamic functions (basic functions)

Length depends on AHU equipment



AVS LITE 8-40 - SUPPLY & EXHAUST

| Rated parameters | | Recommended range of airflow | | | | | |
|--------------------|-------|------------------------------|---------|---------|---------|---------|---------|
| Size | | AVS 008 | AVS 012 | AVS 016 | AVS 020 | AVS 030 | AVS 040 |
| 15 000 | [CFM] | 332 | 427 | 427 | 427 | 480 | 618 |
| 10 000 | | 618 | 618 | 618 | 618 | 819 | 819 |
| 5 000 | | 636 | 819 | 819 | 806 | 1 037 | 1 037 |
| 0 | | 1 037 | 1 037 | 1 185 | 1 524 | 1 524 | 1 567 |
| Min. | | 332 | 427 | 427 | 427 | 480 | 618 |
| Max. | | 2 140 | 1 883 | 1 254 | 924 | 3 091 | 2 719 |
| H _f | | 3.54 | | | | | |
| H | | 21.97 | 21.97 | 24.02 | 27.17 | 32.48 | 37.20 |
| W | | 27.95 | 38.62 | 44.21 | 46.77 | 53.50 | 59.06 |
| W _i | | 24.02 | 34.68 | 40.28 | 42.83 | 49.57 | 55.12 |
| H _i | | 14.49 | 14.49 | 16.54 | 19.69 | 25.00 | 29.72 |
| Main configuration | | Basic configurations | | | | | |
| | L1 | 29,9 | 29,9 | 44,3 | 44,3 | 44,3 | 44,3 |
| | L1 | 44,3 | 44,3 | 44,3 | 44,3 | 58,69 | 58,69 |
| | L1 | 44,3 | 44,3 | 58,69 | 58,69 | 58,69 | 58,69 |
| | L1 | 44,3 | 58,69 | 58,69 | 58,69 | 58,69 | 58,69 |
| | L1 | 44,3 | 58,69 | 58,69 | 58,69 | 58,69 | 58,69 |
| | L1 | 58,69 | 58,69 | 58,69 | 58,69 | 73,09 | 73,09 |
| | L1 | 58,69 | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 |
| | L1 | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 |
| | L1 | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 |

Units with external filters instead of internal are shorter by 14.4 inches

| | | Additional functions | | | | | |
|---------------|------------------|----------------------|-------|-------|-------|-------|-------|
| Empty section | L _{min} | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| | L _{max} | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| Mixing box | L | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |

DIMENSIONS - AVS LITE 8-40 - SUPPLY & EXHAUST

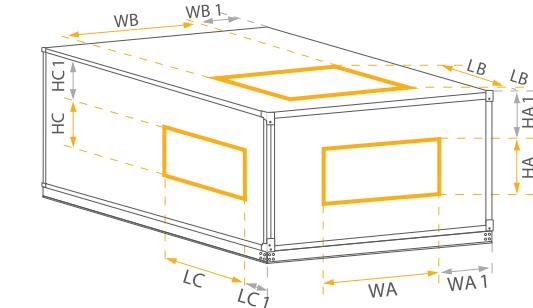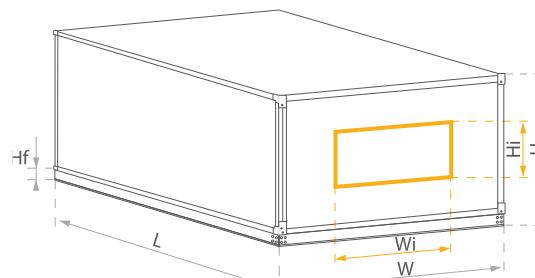

AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | |
|---------------|-------|-------|------|
| UNIT | WA | HA | WA1 |
| AVS 008 | 21.65 | 12.13 | 3.15 |
| AVS 012 | 32.32 | 12.13 | 3.15 |
| AVS 016 | 37.91 | 14.17 | 3.15 |
| AVS 020 | 40.47 | 17.32 | 3.15 |
| AVS 030 | 47.20 | 22.64 | 3.15 |
| AVS 040 | 52.76 | 27.36 | 3.15 |

| END (FS) | | | |
|----------|-------|-------|-------|
| UNIT | WA | HA | WA1 |
| AVS 008 | 17.99 | 7.99 | 5.03 |
| AVS 012 | 25.98 | 7.99 | 6.33 |
| AVS 016 | 34.02 | 7.99 | 5.13 |
| AVS 020 | 25.98 | 12.01 | 10.43 |
| AVS 030 | 34.02 | 12.01 | 9.83 |
| AVS 040 | 40.47 | 17.32 | 9.29 |

| Top (US) | | | |
|----------|-------|-------|-------|
| UNIT | WB | LB | WB1 |
| AVS 008 | 17.99 | 7.99 | 5.03 |
| AVS 012 | 25.98 | 7.99 | 6.33 |
| AVS 016 | 34.02 | 7.99 | 5.13 |
| AVS 020 | 25.98 | 12.01 | 10.43 |
| AVS 030 | 34.02 | 12.01 | 9.83 |
| AVS 040 | 40.47 | 17.32 | 9.29 |

| Top (US) | | | |
|----------|-------|-------|-------|
| UNIT | WB | LB | WB1 |
| AVS 008 | 17.94 | 7.94 | 5.00 |
| AVS 012 | 25.94 | 7.94 | 6.34 |
| AVS 016 | 33.94 | 7.94 | 5.16 |
| AVS 020 | 25.94 | 11.94 | 10.43 |
| AVS 030 | 33.94 | 11.94 | 9.80 |
| AVS 040 | 47.20 | 22.64 | 5.93 |

UNIT CODING

AVS - XXX - R/L - EM / HC / EM

AVS - type of AHU family
 XXX - size of unit (equal to the rated air flow in cfm)
 R/L - inspection side (R- right, L-left)
 EM - symbols of additional functions upstream main functions
 HC - symbols of main thermodynamic functions (basic functions)
 EM - symbols of additional functions downstream main functions
 Length depends on AHU equipment

| Side (BS) | | | | |
|-----------|-------|-------|------|------|
| UNIT | HC | LC | HC1 | LC1 |
| AVS 008 | 10.94 | 7.94 | 4.33 | 3.74 |
| AVS 012 | 10.94 | 7.94 | 4.33 | 3.74 |
| AVS 016 | 12.94 | 7.94 | 4.33 | 3.74 |
| AVS 020 | 15.94 | 11.94 | 4.33 | 3.82 |
| AVS 030 | 20.94 | 11.94 | 4.33 | 3.98 |
| AVS 040 | 16.26 | 14.96 | 6.89 | 8.70 |

AVS LITE 8-40 - CROSS-FLOW PLATE



Main configuration DE*

| | | Basic configurations | | | | | |
|------------------------|----|----------------------|-------|-------|-------|--------|--------|
| AVS-XXX-R-FPV/FVPD_cd | L2 | 58,69 | 58,69 | 87,49 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPV/FPDV_pd | L1 | 58,69 | 58,69 | 73,09 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPHV/FVPD_cd | L2 | 73,09 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 |
| AVS-XXX-R-FPHV/FPDV_pd | L1 | 58,69 | 58,69 | 73,09 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPHV/FVPD_cd | L2 | 58,69 | 58,69 | 87,49 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPHV/FPDV_pd | L1 | 73,09 | 73,09 | 87,49 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPCV/FVPD_cd | L2 | 73,09 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 |
| AVS-XXX-R-FPCV/FPDV_pd | L1 | 58,69 | 58,69 | 87,49 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPCV/FVPD_cd | L2 | 73,09 | 73,09 | 87,49 | 87,49 | 101,89 | 116,28 |
| AVS-XXX-R-FPCV/FPDV_pd | L1 | 73,09 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 |
| AVS-XXX-R-FPHV/FVPD_cd | L2 | 73,09 | 73,09 | 87,49 | 87,49 | 101,89 | 101,89 |
| AVS-XXX-R-FPHV/FPDV_pd | L1 | 73,09 | 73,09 | 87,49 | 87,49 | 87,49 | 101,89 |

* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck





Main configuration DE*

| | | Basic configurations | | | | | |
|------------------------|----|----------------------|-------|-------|--------|--------|--------|
| AVS-XXX-R-FPHC/FVPD_cd | L2 | 58,69 | 58,69 | 87,49 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPHC/FPDV_pd | L1 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 | 116,28 |
| AVS-XXX-R-FPHC/FVPD_cd | L2 | 73,09 | 73,09 | 73,09 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPHC/FPDV_pd | L1 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 | 116,28 |
| AVS-XXX-R-FPHC/FVPD_cd | L2 | 58,69 | 58,69 | 87,49 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPHC/FPDV_pd | L1 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 | 116,28 |
| AVS-XXX-R-FPHC/FVPD_cd | L2 | 73,09 | 73,09 | 73,09 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPHC/FPDV_pd | L1 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 | 116,28 |
| AVS-XXX-R-FPHC/FVPD_cd | L2 | 87,49 | 87,49 | 87,49 | 87,49 | 87,49 | 101,89 |
| AVS-XXX-R-FPHC/FPDV_pd | L1 | 87,49 | 87,49 | 87,49 | 87,49 | 87,49 | 101,89 |

* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck


AVS LITE 12 - 40 WITH ENERGY WHEEL

| Main configuration DE* | | Basic configurations | | | | | |
|---|-------|----------------------|-------|--------|--------|--------|----|
| | | L2 | L1 | L2 | L1 | L2 | L1 |
|  | 73,09 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 | |
| | 87,49 | 87,49 | 87,49 | 87,49 | 101,89 | 101,89 | |
|  | 58,69 | 58,69 | 87,49 | 87,49 | 87,49 | 101,89 | |
| | 87,49 | 87,49 | 87,49 | 87,49 | 116,28 | 116,28 | |
|  | 73,09 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 | |
| | 87,49 | 87,49 | 87,49 | 87,49 | 116,28 | 116,28 | |
|  | 58,69 | 58,69 | 87,49 | 87,49 | 87,49 | 101,89 | |
| | 87,49 | 87,49 | 87,49 | 101,89 | 116,28 | 116,28 | |
|  | 73,09 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 | |
| | 87,49 | 87,49 | 87,49 | 101,89 | 116,28 | 116,28 | |
|  | 58,69 | 58,69 | 87,49 | 87,49 | 87,49 | 101,89 | |
| | 87,49 | 87,49 | 87,49 | 101,89 | 116,28 | 116,28 | |
|  | 73,09 | 73,09 | 73,09 | 87,49 | 101,89 | 101,89 | |
| | 87,49 | 87,49 | 87,49 | 101,89 | 116,28 | 116,28 | |

* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck

| Rated parameters | | Recommended range of airflow | | | | | |
|------------------|-------|------------------------------|---------|---------|---------|---------|------|
| Size | | AVS 012 | AVS 016 | AVS 020 | AVS 030 | AVS 040 | |
| 12 000 | [CFM] | | | | | | |
| | | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | |
| 8 000 | | 618 | 618 | 819 | 819 | 1037 | 1037 |
| | | 2179 | 1817 | 1339 | 2664 | 2486 | 1832 |
| 4 000 | | | | | | | |
| | | 0 | 1037 | 1037 | 1037 | 1037 | 1037 |
| Min. | | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | | 618 | 618 | 819 | 819 | 1037 | 1037 |
| Max. | | 2179 | 1817 | 1339 | 2664 | 2486 | 1832 |
| | | | | | | | |
| H_f | | | | | | | |
| | | | | | | | |
| H | | | | | | | |
| | | | | | | | |
| W | | | | | | | |
| | | | | | | | |
| W_i | | | | | | | |
| | | | | | | | |
| H_i | | | | | | | |
| | | | | | | | |
| H_2 | | | | | | | |
| | | | | | | | |


| Main configuration DE* | | Basic configurations | | | | | |
|---|-------|----------------------|-------|-------|-------|-------|----|
| | | L2 | L1 | L2 | L1 | L2 | L1 |
|  | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | 58,69 | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | |
|  | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | 58,69 | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | |
|  | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
|  | 58,69 | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
|  | 58,69 | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
|  | 58,69 | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
|  | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | 73,09 | 73,09 | 87,49 | 87,49 | 87,49 | 87,49 | |
|  | 58,69 | 58,69 | 73,09 | 73,09 | 87,49 | 87,49 | |
| | 73,09 | 73,09 | 87,49 | 87,49 | 87,49 | 87,49 | |
|  | 58,69 | 73,09 | 73,09 | 73,09 | 73,09 | 73,09 | |
| | 73,09 | 73,09 | 87,49 | 87,49 | 87,49 | 87,49 | |
|  | 58,69 | 58,69 | 73,09 | 73,09 | 87,49 | 87,49 | |
| | 73,09 | 73,09 | 87,49 | 87,49 | 87,49 | 87,49 | |

* Include Droplet Eliminator after Cooling Coil

L1- doesn't cover empty space in bottom deck



DIMENSIONS AVS LITE 8-40 - CROSS-FLOW PLATE

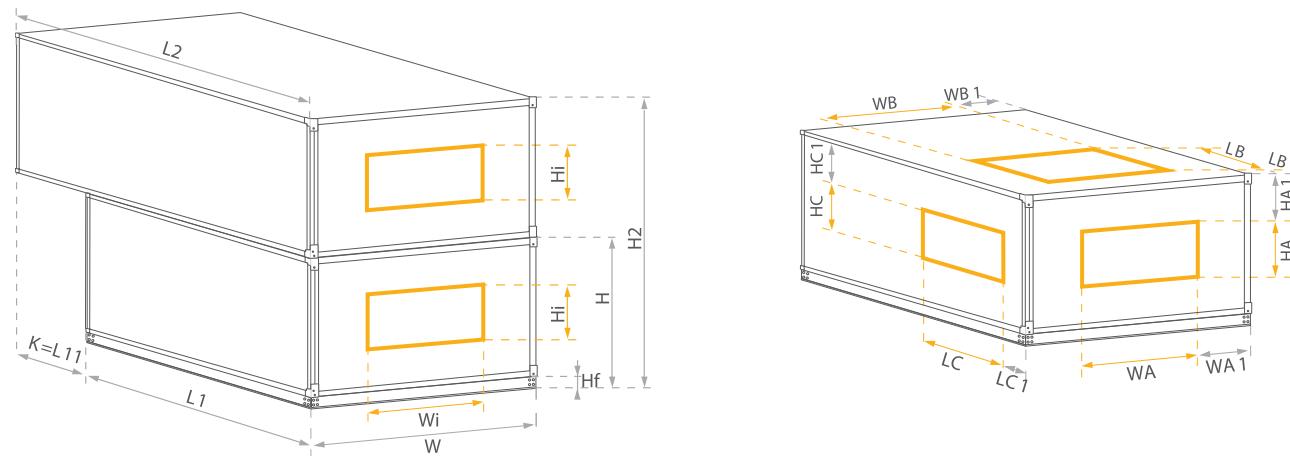


AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | | |
|---------------|-------|-------|------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 008 | 21.65 | 12.13 | 3.15 | 3.15 |
| AVS 012 | 32.32 | 12.13 | 3.15 | 3.15 |
| AVS 016 | 37.91 | 14.17 | 3.15 | 3.15 |
| AVS 020 | 40.47 | 17.32 | 3.15 | 3.15 |
| AVS 030 | 47.20 | 22.64 | 3.15 | 3.15 |
| AVS 040 | 52.76 | 27.36 | 3.15 | 3.15 |

| END (FS) | | | | |
|----------|-------|-------|-------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 008 | 17.97 | 7.97 | 5.00 | 5.24 |
| AVS 012 | 25.97 | 7.97 | 6.34 | 5.24 |
| AVS 016 | 33.97 | 7.97 | 5.16 | 6.26 |
| AVS 020 | 25.97 | 11.97 | 10.43 | 5.83 |
| AVS 030 | 33.97 | 11.97 | 9.80 | 8.50 |
| AVS 040 | 40.51 | 17.36 | 9.29 | 8.19 |

DIMENSIONS - AVS LITE 12 - 40 WITH ENERGY WHEEL

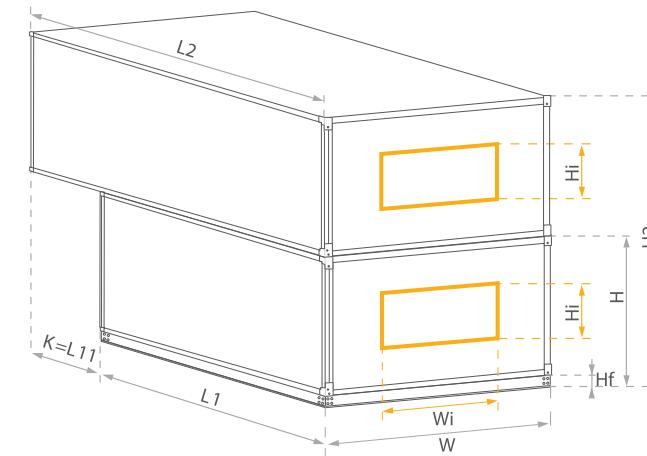

AIR INLET / DISCHARGE DIMENSIONS

| END FULL (FF) | | | | |
|---------------|-------|-------|------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 012 | 32.32 | 12.13 | 3.15 | 3.15 |
| AVS 016 | 37.91 | 14.17 | 3.15 | 3.15 |
| AVS 020 | 40.47 | 17.32 | 3.15 | 3.15 |
| AVS 030 | 47.20 | 22.64 | 3.15 | 3.15 |
| AVS 040 | 52.76 | 27.36 | 3.15 | 3.15 |

| END (FS) | | | | |
|----------|-------|-------|-------|------|
| UNIT | WA | HA | WA1 | HA1 |
| AVS 012 | 25.97 | 7.97 | 6.34 | 5.24 |
| AVS 016 | 33.97 | 7.97 | 5.16 | 6.26 |
| AVS 020 | 25.97 | 11.97 | 10.43 | 5.83 |
| AVS 030 | 33.97 | 11.97 | 9.80 | 8.50 |
| AVS 040 | 40.51 | 17.36 | 9.29 | 8.19 |

| Side (BS) | | | | |
|-----------|-------|-------|------|------|
| UNIT | HC | LC | HC1 | LC1 |
| AVS 008 | 10.94 | 7.94 | 4.33 | 3.74 |
| AVS 012 | 10.94 | 7.94 | 4.33 | 3.74 |
| AVS 016 | 12.94 | 7.94 | 4.33 | 3.74 |
| AVS 020 | 15.94 | 11.94 | 4.33 | 3.82 |
| AVS 030 | 20.94 | 11.94 | 4.33 | 3.98 |
| AVS 040 | 16.26 | 14.96 | 6.89 | 8.70 |

| Side (BS) | | | | |
|-----------|-------|-------|------|------|
| UNIT | HC | LC | HC1 | LC1 |
| AVS 012 | 10.94 | 7.94 | 4.33 | 3.74 |
| AVS 016 | 12.94 | 7.94 | 4.33 | 3.74 |
| AVS 020 | 15.94 | 11.94 | 4.33 | 3.82 |
| AVS 030 | 20.94 | 11.94 | 4.33 | 3.98 |
| AVS 040 | 16.26 | 14.96 | 6.89 | 8.70 |

UNIT CODING

AVS - XX

AVS - type of AHU family

XXX - size of unit (equal to the rated air flow in cfm*0.001)

R/L - inspection side (R-right, L-left)

PHC - symbols of main thermodynamic functions (basic functions)

Length depends on AHU equipment

UNIT CODING

AVS - XX

AVS - type of AHU family

XXX - size of unit (equal to the rated air flow in cfm*0.001)

R/L - inspection side (R-right, L-left)

PHC - symbols of main thermodynamic functions (basic functions)



Length depends on AHU equipment

AVS - VERTICAL CONFIGURATIONS

| Rated parameters | | Recommended range of airflow | | | | | | | | | | | | | | | | | | | | | | | | |
|------------------|--------|------------------------------|-------|-------|---------|-------|-------|---------|-------|-------|---------|-------|-------|---------|-------|-------|---------|-------|-------|-------|-------|--------|-------|-------|-------|-------|
| Size | | AVS 008 | | | AVS 012 | | | AVS 016 | | | AVS 020 | | | AVS 030 | | | AVS 040 | | | | | | | | | |
| 15 000 | [CFM] | 332 | 427 | 427 | 427 | 480 | 618 | 618 | 618 | 636 | 819 | 819 | 819 | 819 | 806 | 1 037 | 1 037 | 1 037 | 1 185 | 1 524 | 1 524 | 1 524 | 1 567 | 1 945 | 1 945 | 1 945 |
| 10 000 | | 332 | 427 | 427 | 427 | 480 | 618 | 618 | 618 | 636 | 819 | 819 | 819 | 819 | 806 | 1 037 | 1 037 | 1 037 | 1 185 | 1 524 | 1 524 | 1 524 | 1 567 | 1 945 | 1 945 | 1 945 |
| 5 000 | | 332 | 427 | 427 | 427 | 480 | 618 | 618 | 618 | 636 | 819 | 819 | 819 | 819 | 806 | 1 037 | 1 037 | 1 037 | 1 185 | 1 524 | 1 524 | 1 524 | 1 567 | 1 945 | 1 945 | 1 945 |
| 0 | | 332 | 427 | 427 | 427 | 480 | 618 | 618 | 618 | 636 | 819 | 819 | 819 | 819 | 806 | 1 037 | 1 037 | 1 037 | 1 185 | 1 524 | 1 524 | 1 524 | 1 567 | 1 945 | 1 945 | 1 945 |
| Min. | | 332 | 427 | 427 | 427 | 480 | 618 | 618 | 618 | 636 | 819 | 819 | 819 | 819 | 806 | 1 037 | 1 037 | 1 037 | 1 185 | 1 524 | 1 524 | 1 524 | 1 567 | 1 945 | 1 945 | 1 945 |
| Max. | | 2 140 | 1 883 | 1 254 | 924 | 3 091 | 2 719 | 1 817 | 1 339 | 4 096 | 3 605 | 2 486 | 1 832 | 5 186 | 4 564 | 3 331 | 2 454 | 7 622 | 6 708 | 4 835 | 3 563 | 10 078 | 8 559 | 6 697 | 4 934 | |
| H _{fd} | | 3.54 | | | | | | | | | | | | 0.00 | | | | | | | | | | | | |
| H _{fu} | | 0.00 | | | | | | | | | | | | 0.00 | | | | | | | | | | | | |
| H | [inch] | 21.97 | 21.97 | 21.97 | 21.97 | 21.97 | 24.02 | 24.02 | 24.02 | 24.02 | 27.17 | 27.17 | 27.17 | 27.17 | 27.17 | 32.48 | 32.48 | 32.48 | 32.48 | 37.20 | 37.20 | 37.20 | 37.20 | 37.20 | 37.20 | 37.20 |
| W | | 27.95 | 38.62 | 38.62 | 38.62 | 38.62 | 44.21 | 44.21 | 44.21 | 44.21 | 46.77 | 46.77 | 46.77 | 46.77 | 46.77 | 53.50 | 53.50 | 53.50 | 53.50 | 59.06 | 59.06 | 59.06 | 59.06 | 59.06 | 59.06 | 59.06 |
| W _i | | 24.02 | 34.68 | 34.68 | 34.68 | 34.68 | 40.28 | 40.28 | 40.28 | 40.28 | 42.83 | 42.83 | 42.83 | 42.83 | 42.83 | 49.57 | 49.57 | 49.57 | 49.57 | 55.12 | 55.12 | 55.12 | 55.12 | 55.12 | 55.12 | 55.12 |
| H _{ui} | | 19.69 | 19.69 | 19.69 | 19.69 | 19.69 | 19.69 | 19.69 | 19.69 | 19.69 | 25.00 | 25.00 | 25.00 | 25.00 | 25.00 | 25.00 | 25.00 | 25.00 | 25.00 | 29.72 | 29.72 | 29.72 | 29.72 | 29.72 | 29.72 | 29.72 |
| H _{di} | | 14.49 | 14.49 | 14.49 | 14.49 | 14.49 | 16.54 | 16.54 | 16.54 | 16.54 | 19.69 | 19.69 | 19.69 | 19.69 | 19.69 | 25.00 | 25.00 | 25.00 | 25.00 | 29.72 | 29.72 | 29.72 | 29.72 | 29.72 | 29.72 | 29.72 |
| H ₂ | | 45.59 | 45.59 | 45.59 | 45.59 | 45.59 | 47.64 | 47.64 | 47.64 | 47.64 | 56.10 | 56.10 | 56.10 | 56.10 | 56.10 | 61.42 | 61.42 | 61.42 | 61.42 | 70.87 | 70.87 | 70.87 | 70.87 | 70.87 | 70.87 | 70.87 |

| Basic configurations | | | | | | | | | | | | | |
|----------------------|----|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|-------|
| AVS(v)-XXX-R-HV | L2 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| AVS(v)-XXX-R-CV | L1 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| AVS(v)-XXX-R-HCV | L2 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| AVS(v)-XXX-R-HCV | L1 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| AVS(v)-XXX-R-MHV | L2 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| AVS(v)-XXX-R-MCV | L1 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 |
| AVS(v)-XXX-R-MHCV | L2 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |
| AVS(v)-XXX-R-MCHV | L1 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 | 58.65 |
| AVS(v)-XXX-R-MCHV | L2 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 | 29.86 |

DIMENSIONS - VERTICAL CONFIGURATIONS

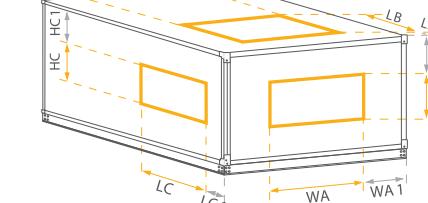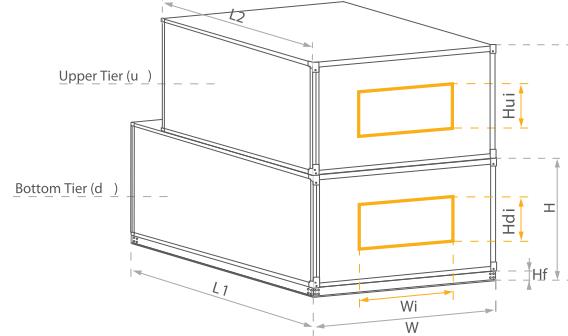

| END FULL (FF) | | | | |
|---------------|-------|-------|------|------|
| Unit | WA | HA | WA1 | HA1 |
| AVS008 | 21.63 | 17.31 | 3.13 | 3.13 |
| AVS012 | 32.31 | 17.31 | 3.13 | 3.13 |
| AVS016 | 37.94 | 17.31 | 3.13 | 3.13 |
| AVS020 | 40.50 | 22.63 | 3.13 | 3.13 |
| AVS030 | 47.19 | 22.63 | 3.13 | 3.13 |
| AVS 040 | 52.75 | 27.38 | 3.13 | 3.13 |

| END (FS) | | | | |
|----------|-------|-------|-------|-------|
| Unit | WA | HA | WA1 | HA1 |
| AVS008 | 18.00 | 8.00 | 4.60 | 11.12 |
| AVS012 | 26.00 | 8.00 | 5.90 | 11.12 |
| AVS016 | 34.00 | 8.00 | 4.70 | 10.62 |
| AVS020 | 26.00 | 12.00 | 10.00 | 11.94 |
| AVS030 | 34.00 | 12.00 | 9.40 | 11.94 |
| AVS 040 | 48.00 | | | |



05

Connection and
controls



CONNECTING POINT

The Connecting Point is the power supply and VFD Enclosure, the internal wiring system of the air-handling unit related to power supply and control of fan motors. It is mounted separately for the supply and exhaust fan sections.

It consists of a casing, a frequency converter (VFD), surge protection, emergency (service) switch, strip connector, factory-produced internal power circuits, and control wiring of the fan drive system (motor-inverter). In the case of vertical air-handling units, an external wired outlet is mounted on the casing and connected to the Connecting Point.

The Connecting Point is equipped with aggregate terminals for power supply circuits; inverter circuits are factory-connected to these terminals.



CONSTRUCTION AND WIRING



THE MAIN BENEFITS OF AIR-HANDLING UNITS EQUIPPED WITH THE CONNECTING POINT ARE AS FOLLOWS:

- » the certainty of correctness of internal connections supplying the motor and the VFD
- » reliability of factory-tested connections and air-handling unit operation
- » on-site time-savings on wiring
- » lower costs of the whole installation
- » factory installation of the service switch
- » clear liability of the producer for the connection and configuration of inverters and motors



CONTROLS

VTS uses control algorithms that have been developed with an emphasis on energy savings, while at the same time maintaining the required parameters of the air supplied and ensuring reliability of our units.

For management of our American VENTUS air handling units we recommend our control application based on PLC controller, supporting all advanced control functions and variable ways of external communication including integration with Building Management Systems.

NEW FEATURES

MEASUREMENT AND CONTROL OF THE CONSTANT AIR VOLUME

- » adjustment of the preset constant air volume under changing flow resistance - compensation of changing internal resistance of the AHU (e.g. with varying degrees of air filter dirt, different setpoint of the mixing box, etc.)
- » adjustment of the fan power to the current needs of the installation
- » readiness of the AHU to work with the required performance immediately after installation

CONSTANT PRESSURE CONTROL WITH VARIABLE AIR VOLUME

- » control of constant, preset air pressure at variable volume (efficiency change is carried out through the air distribution system – e.g. VAV controllers)

CO₂

- » automatic modulation of the amount of outside air (keeping the CO₂ concentration below the set value)
- » optimization of consumption of heat and electricity

MAIN ELEMENTS

HMI SERVICE



Function and Application

- » setting and reading of advanced operating parameters of ventilation or supply units
- » management and cancellation of units operational errors is done by full text description
- » management of the controller main calendar

Operation parameters

- » power supply: directly from the UPC3 controller
- » communication port: serial port, RS485 standard
- » communication cable length: max. 3,600ft
- » connection method: 1:1
- » protection class: NEMA 2
- » ambient temperature: -4 +140°F / φ<85%, without condensation

ELECTRIC HEATER CONTROL

- » smooth control system that adjusts power to the current demand

HUMIDITY CONTROL

- » control over air humidifying - both evaporative and steam
- » supports control of the drying process

MIXING BOX CONTROL

- » smooth control of the mixing box, external signal or as in the CO₂ control function, etc.
- » optimization of the ventilation air to save energy

VARIABLE FREQUENCY DRIVES



Function and Application

- » smooth regulation of the AHU air flow by proportional change of the motor-fan unit rotational speed
- » maintaining fixed AHU operating parameters at varying air flow resistance of the ductworks
- » protection of maximal value of motor current
- » controlling of fan start-up with simultaneous protection of maximal value of start-up current
- » integration with external analog and binary signals
- » displaying and modification of fan-set working parameters

Operation parameters

- » analog Inputs:
 - 1 insulated input. Levels: (0 to 10) V or (0 to 20) mA or (4 to 20) mA
 - programmable functions
- » digital Inputs:
 - 4 insulated inputs
 - programmable functions:
 - Active high (PNP)
 - Active low (NPN)
- » analog Output
 - 1 insulated output. Level (0 to 10) V or (0 to 20) mA or (4 to 20) mA
 - programmable functions
- » relay Output
 - 1 relay with NA/NF contact.
 - maximum voltage: 240 VAC
 - maximum current 0.5 A
 - programmable functions
- » communication Interface RS 485
 - insulated RS485
 - modbus-RTU protocol with maximum communication of 38.4kbps
- » enclosure
 - NEMA1/IP20



DUCT TEMPERATURE SENSOR

**Function and Application**

- » measurement of the temperature of supply, exhaust and outside air
- » securing max. and min. temperature of supply air
- » protection against frost on the energy recovery unit via the temperature measurement of air exhausted upstream the energy recovery unit

Operation parameters

- » measurement range: -40°F -158 °F
- » air humidity: 5 - 100 %
- » measuring element: NTC 10k
- » output signal: resistance
- » cables length: max. 300 ft
- » protection class: IP 54

THREE-WAY VALVE WITH ELECTRIC ACTUATOR

**Function and Application**

- » temperature adjustment of the medium flowing through the hydronic coil
- » quality hydronic heater capacity regulation (system based on additional recirculation pump)
- » quantity hydronic cooler capacity regulation

Operation parameters

- » actuator:
 - adjustment range: 0 -100%
 - supply voltage: 24 V AC/DC
 - input signal: 0-10 V DC
 - rotation angle: 90°
 - protection class: NEMA 2
 - ambient temperature: -22 +122 °F
- » valve:
 - operating characteristics: Equal percentage/proportional Cv: 3 / 4.7 / 7.4 / 19 / 29 / 46 / 68 / 91
 - differential Pressure: 50 psi for typical applications
 - medium temperature: 0°F - 250°F

DIFFERENTIAL PRESSURE SWITCH

**Function and Application**

- » monitoring the filter contamination in the Air Handling Unit by measuring the difference of static pressure before and after the filter
- » control of the operation of a direct driven fan unit in case of cooperation with electric heater

Operation parameters

- » measurement: 0.12-1.20 in WG – filters of class MERV 6 - 15
- » rated operating voltage: 250V AC (Imax=3A)
- » output signal: potential-free contact, NO or NC according to the application
- » switching capacity: 1mln of cycles (at temp. of 140 °F)
- » protection class: NEMA 3
- » ambient temperature: -4 °F +140 °F

0-10 V AIR DAMPER ACTUATOR

**Function and Application**

- » mixing ratio control for outdoor and room-exhausted air (economizer): 0-10 V actuator
- » control of bypass air damper opening level for the Plate Cross-Flow – anti-frost protection of the energy recovery system
- » 0-10 V actuator:
 - actuator with spring return
 - economizer fresh air side
- » actuator with no spring return:
 - economizer return air side
 - by-pass damper for cross-plate based energy recovery system

Operation parameters

- » regulation method: smooth 0-100%
- » supply voltage: 24 VAC
- » input signal: 0 -10 VDC
- » rated torque: 90 in-lbs
- » rotation angle 90°
- » full opening time: 0-10 V: 80 - 90s;
- » spring-forced return: 10s
- » max. air damper area: 43 ft²
- » protection class: NEMA 2
- » ambient temperature: -22 +122 °F

LOW LIMIT THERMOSTAT SWITCH

**Function and Application**

- » when the air temperature drops below the minimum allowable temperature, signal from the thermostat stops AHU fans, closes external air dampers and adjusts control valve of the heater to the max. flow of heating medium
- » switching into permanent alarm condition if the AHU protection is triggered three times within an hour

Operation parameters

- » measurement range: -0.4 +59 °F
- » default switching threshold setting: 41 °F
- » hysteresis: 1.7 - 12K
- » Rated operating voltage: 30 V DC, 230 VAC
- » output signal: potential-free (switchover contact)
- » protection class: NEMA 3

HUMIDITY SENSOR

**Function and Application**

- » multiple ranges as measurement windows available
- » innovative self-calibrating algorithm
- » long term stability and accuracy

Operation parameters

- » microcontroller based design
- » supply voltage: 24 V AC/DC
- » 1 analogue output (0-10 VDC / 0-20 mA)
- » modbus RTU (RS485) Communication



CONTROL APPLICATIONS LIST

AP - control system application for air supply-exhaust units with cross-flow heat exchanger

| Application code | Functions available in particular applications | | | | | |
|------------------|--|----|----|----------|-----------|--------|
| | HW | DX | DX | PRC. BPS | MIX. CMBR | SUMMER |
| AP 32 | | | | ✓ | | |
| AP 41 | ✓ | | | ✓ | | |
| AP 33 | | ✓ | | ✓ | | |
| AP 36 | ✓ | ✓ | | ✓ | | |
| AP 37 | | | ✓ | ✓ | | |
| AP 40 | ✓ | | ✓ | ✓ | | |
| AP 160 | | | | ✓ | | ✓ |
| AP 161 | ✓ | | | ✓ | | ✓ |
| AP 164 | | ✓ | | ✓ | | ✓ |
| AP 165 | ✓ | ✓ | | ✓ | | ✓ |
| AP 168 | | | ✓ | ✓ | | ✓ |
| AP 169 | ✓ | | ✓ | ✓ | | ✓ |


AR - control system application for air supply-exhaust units with thermal wheel

| Application code | Functions available in particular applications | | | | | |
|------------------|--|----|----|----------|-----------|--------|
| | HW | DX | DX | PRC. BPS | MIX. CMBR | SUMMER |
| AP 0 | | | | | | |
| AP 1 | ✓ | | | | | |
| AP 4 | | ✓ | | | | |
| AP 5 | ✓ | ✓ | | | | |
| AP 8 | | | ✓ | | | |
| AP 9 | ✓ | | ✓ | | | |
| AP 128 | | | | | | ✓ |
| AP 129 | ✓ | | ✓ | | | ✓ |
| AP 132 | | ✓ | | | | ✓ |
| AP 133 | ✓ | ✓ | | | | ✓ |
| AP 136 | | | ✓ | | | ✓ |
| AP 137 | ✓ | | ✓ | | | ✓ |

AS - control system application for air supply units

| Application code | Functions available in particular applications | | | | | |
|------------------|--|----|----|----------|-----------|--------|
| | HW | DX | DX | PRC. BPS | MIX. CMBR | SUMMER |
| AP 1 | ✓ | | | | | |
| AP 4 | | ✓ | | | | |
| AP 5 | ✓ | ✓ | | | | |
| AP 8 | | | ✓ | | | |
| AP 9 | ✓ | | ✓ | | | |
| AP 65 | ✓ | | | | ✓ | |
| AP 68 | | ✓ | | | ✓ | |
| AP 69 | ✓ | ✓ | | | ✓ | |
| AP 72 | | | ✓ | | ✓ | |
| AP 73 | ✓ | | ✓ | | ✓ | |
| AP 193 | ✓ | | | | ✓ | ✓ |
| AP 196 | | ✓ | | | ✓ | ✓ |
| AP 197 | ✓ | ✓ | | | ✓ | ✓ |
| AP 200 | | | ✓ | | ✓ | ✓ |
| AP 201 | ✓ | | ✓ | | ✓ | ✓ |

SUPPLY AHUS

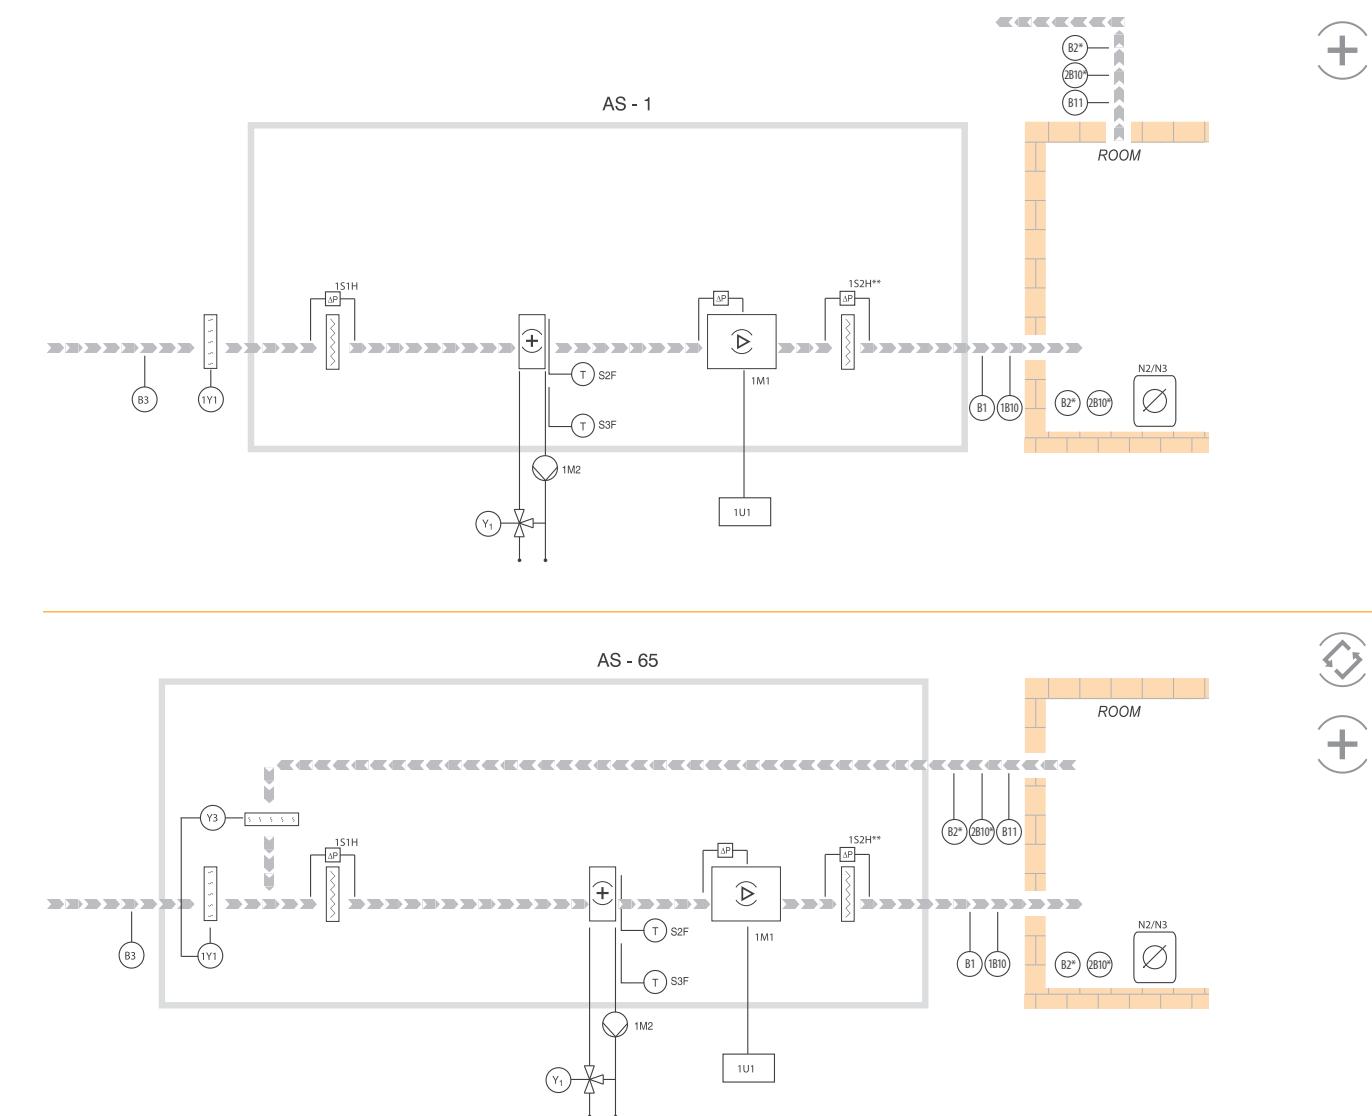

CONTROL





- » control of room temperature, or supply or exhaust air temperature
 - » control of the energy recovery level – first stage of heating/cooling
 - » air flow control
 - » operation according to calendar – temperature, efficiency, operation mode (OPERATION, STAND-BY, STOP)
 - » STAND-BY – maintaining the minimum, set indoor temperature.
- * Initial heating of external air

INFORMATION

- » information on outdoor, supply, exhaust and indoor air temperatures
- » filter contamination info
- » alarm status info
- » analog and digital input and output status info

PROTECTION

- » limiting the allowed supply air temperature
- » fan unit protection – the function is active:
 - if an electric heater is present
- » overload protection of a drive unit
- » anti-frost protection of a water heater
- » protection against overheating of an electric heater
- » optional protection against minimal and maximal temperature of medium returning from the water heater with use of Strap-on temperature sensor, standard NTC 10K
- » the control application layouts have been prepared on the basis of water exchangers
- » the quantity of applied pressure switches for filters depends on the filter configuration

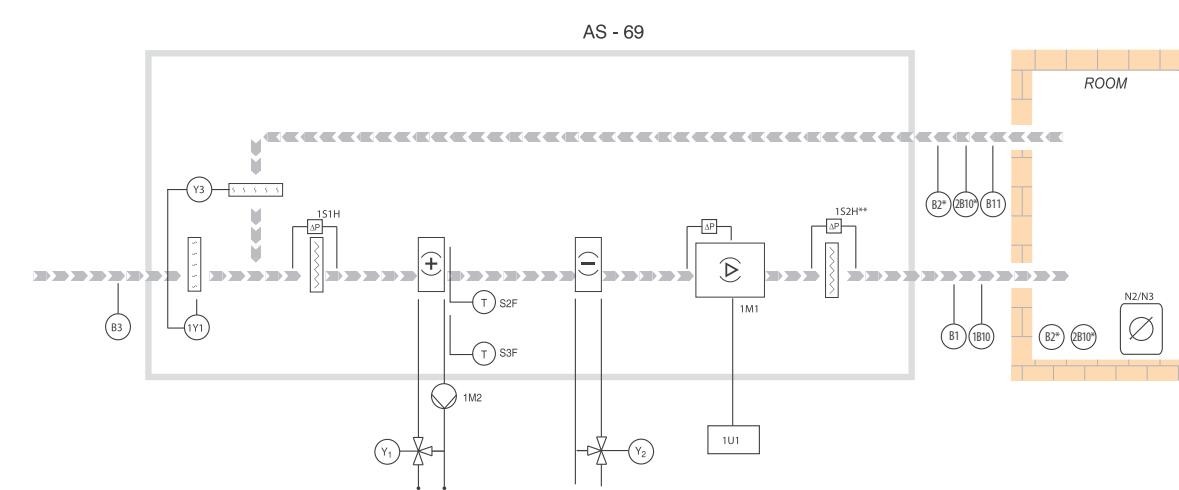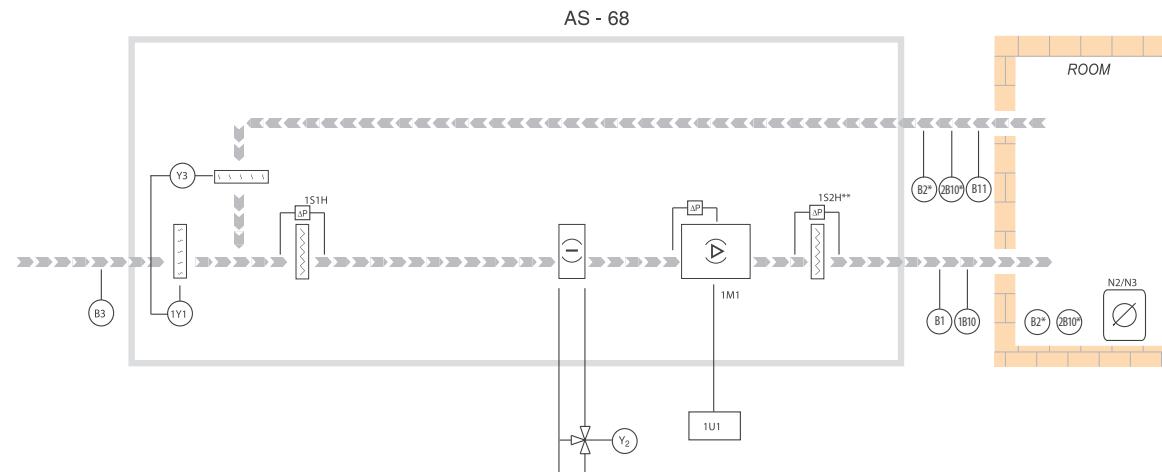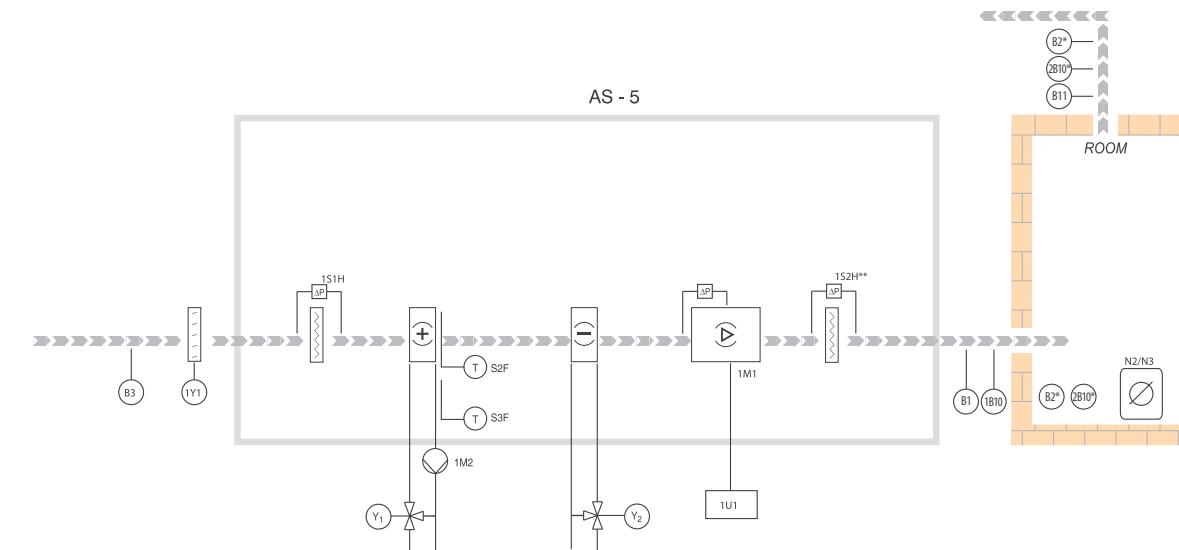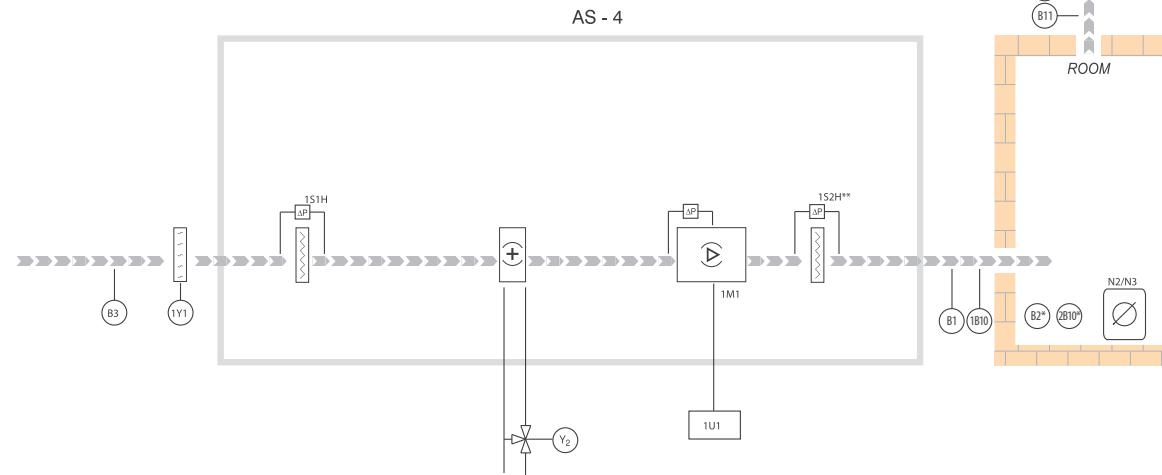

CONTROL

- » control of room temperature, optionally supply or exhaust air temperature
 - » control of the energy recovery level – first stage of heating/cooling
 - » air flow control
 - » operation according to calendar – temperature, efficiency, operation mode (OPERATION, STAND-BY, STOP)
 - » STAND-BY – maintaining the minimum, set indoor temperature.
- * Initial heating of external air.

INFORMATION

- » information on outdoor, supply, exhaust and indoor air temperatures
- » filter contamination info
- » alarm status info
- » analog and digital input and output status info

PROTECTION

- » limiting the allowed supply air temperature
- » fan unit protection – the function is active:
 - if an electric heater is applied
- » overload protection of a drive unit
- » anti-frost protection of a water heater
- » protection against overheating of an electric heater
- » the control application layouts have been prepared on the basis of water exchangers
- » the quantity of applied pressure switches for filters depends on the filters' configuration




CONTROL

- » control of room temperature, optionally supply or exhaust air temperature
 - » control of the energy recovery level – first stage of heating/cooling
 - » air flow control
 - » operation according to calendar – temperature, efficiency, operation mode (OPERATION, STAND-BY, STOP)
 - » STAND-BY – maintaining the minimum, set indoor temperature.
- * Initial heating of external air.

INFORMATION

- » information on outdoor, supply, exhaust and indoor air temperatures
- » filter contamination info
- » alarm status info
- » analog and digital input and output status info



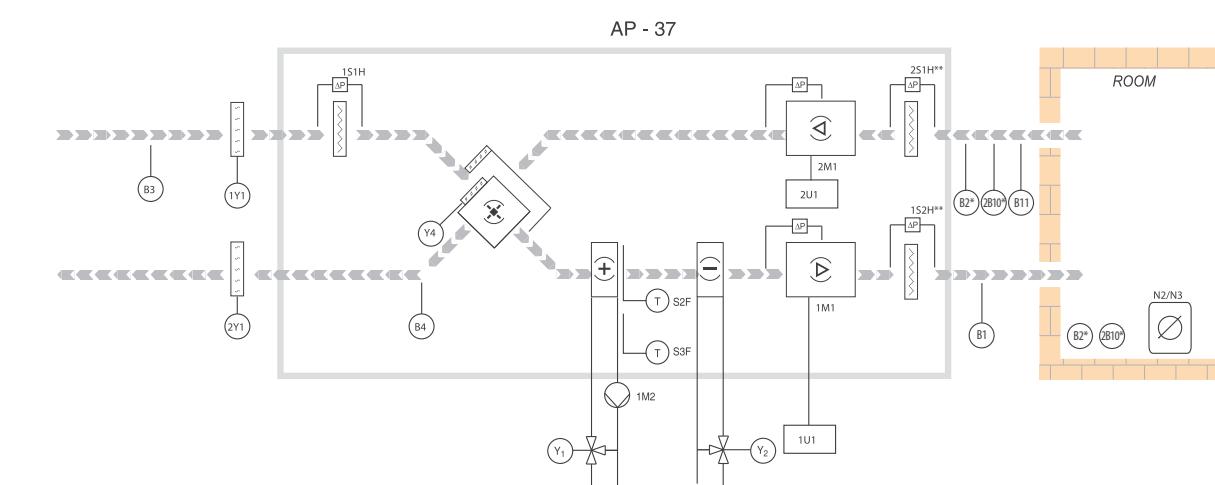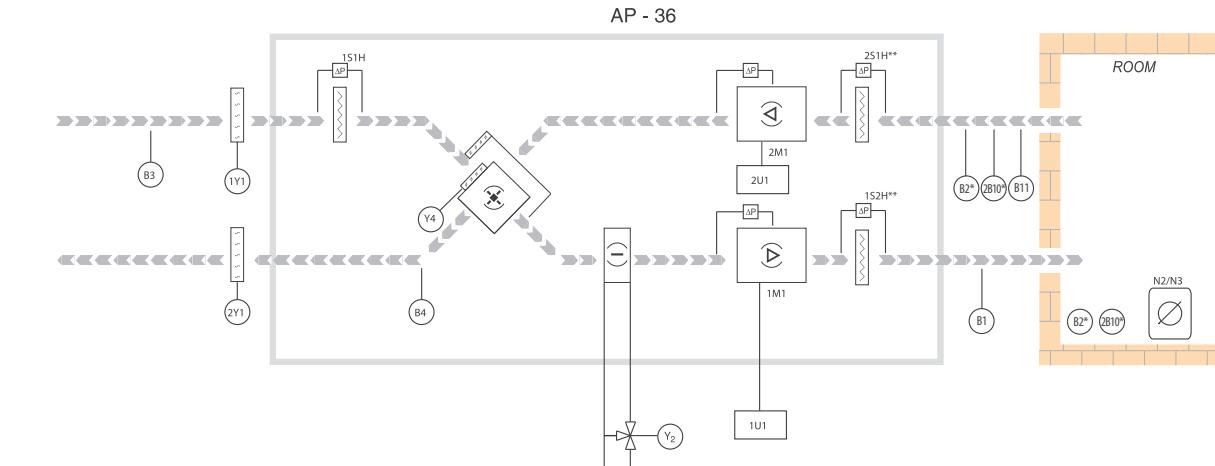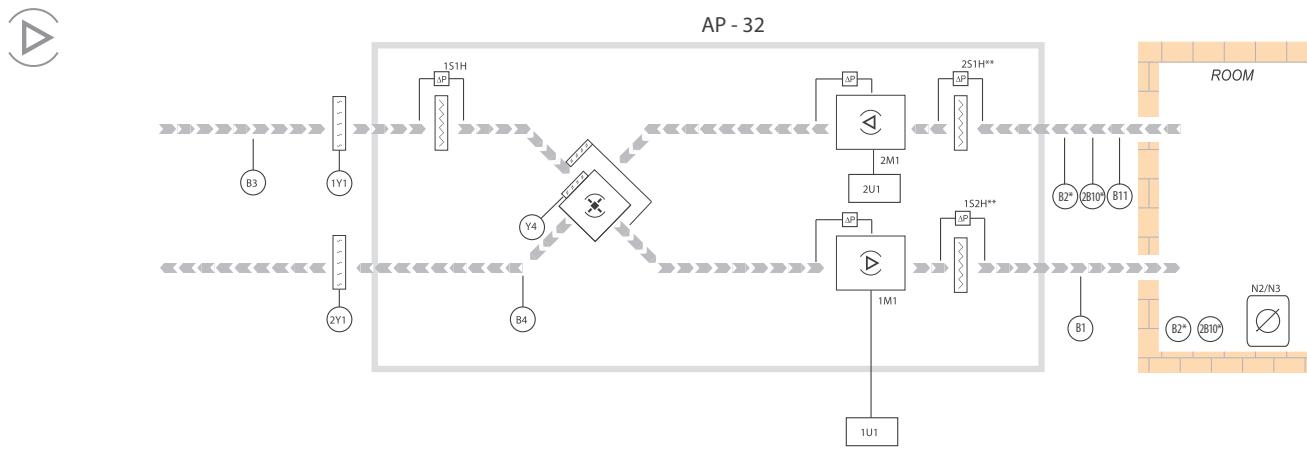

CONTROL

- » control of room temperature, optionally supply or exhaust air temperature
 - » control of the energy recovery level – first stage of heating/cooling
 - » air flow control
 - » operation according to calendar – temperature, efficiency, operation mode (OPERATION, STAND-BY, STOP)
 - » STAND-BY – maintaining the minimum, set indoor temperature
- * Initial heating of external air.

INFORMATION

- » information on outdoor, supply, exhaust and indoor air temperatures
- » filter contamination info
- » alarm status info
- » analog and digital input and output status info

PROTECTION

- » limiting the allowed supply air temperature
- » fan unit protection – the function is active:
 - if an electric heater is applied
- » overload protection of drive unit
- » anti-frost protection of a water heater
- » protection against overheating of an electric heater
- » anti-frost protection of an energy recovery exchanger
- » optional protection against minimal and maximal temperature of medium returning from the water heater with use of Strap-on temperature sensor, standard NTC 10K
- » the control application layouts have been prepared on the basis of water exchangers
- » the quantity of applied pressure switches for filters depends on the filters' configuration
- » optional Strap-on temperature sensor is not a part of VTS offer

CONTROL





- » control of room temperature, optionally supply or exhaust air temperature
 - » control of the energy recovery level – first stage of heating/cooling
 - » air flow control
 - » operation according to calendar – temperature, efficiency, operation mode (OPERATION, STAND-BY, STOP)
 - » STAND-BY – maintaining the minimum, set indoor temperature
- * Initial heating of external air.

INFORMATION

- » information on outdoor, supply, exhaust and indoor air temperatures
- » filter contamination info
- » alarm status info
- » analog and digital input and output status info

PROTECTION

- » limiting the allowed supply air temperature
- » fan unit protection – the function is active:
 - if an electric heater is applied
- » overload protection of a drive unit
- » anti-frost protection of a water heater
- » protection against overheating of an electric heater
- » the control application layouts have been prepared on the basis of water exchangers
- » the quantity of applied pressure switches for filters depends on the filters' configuration

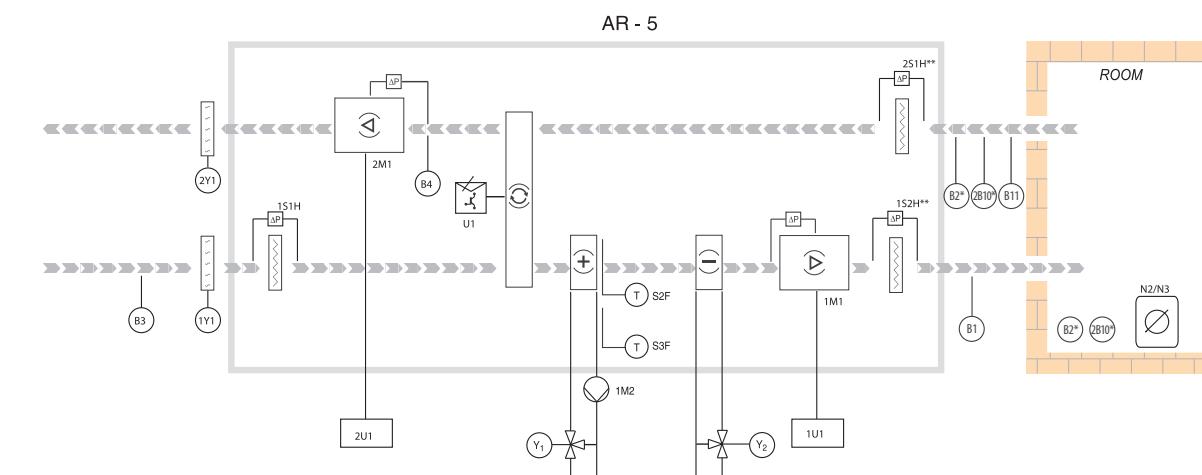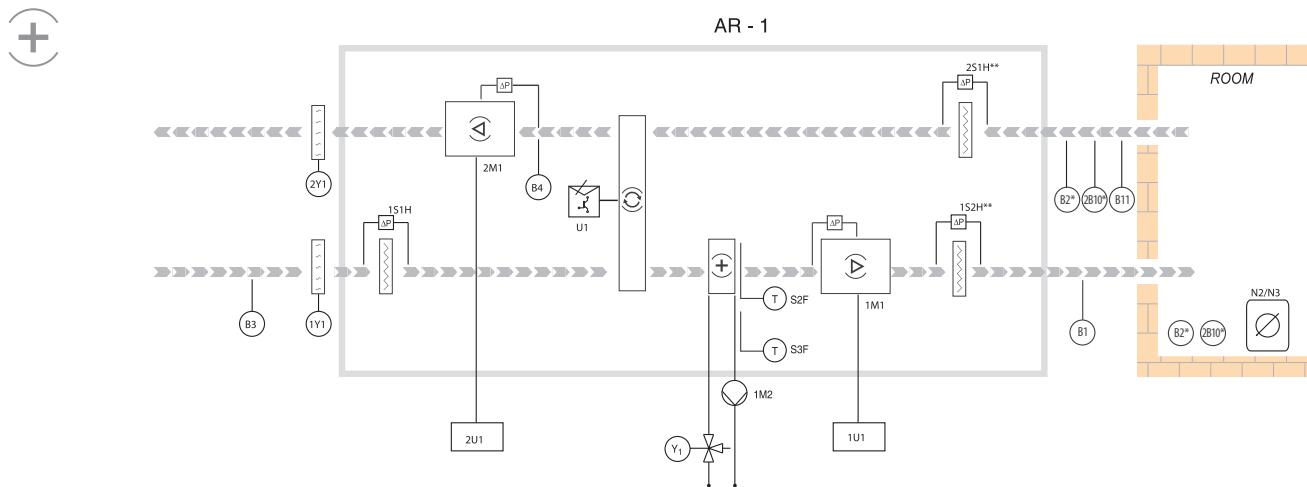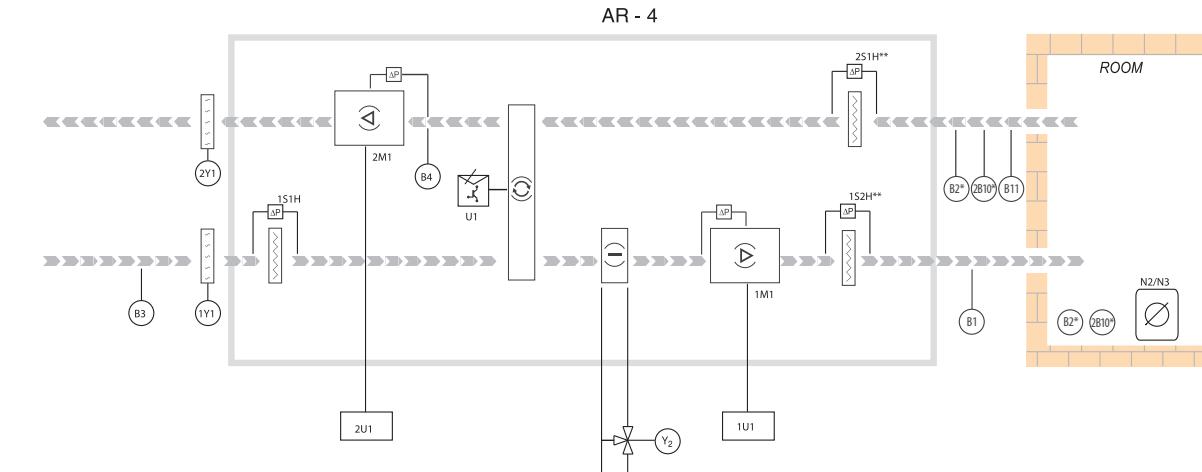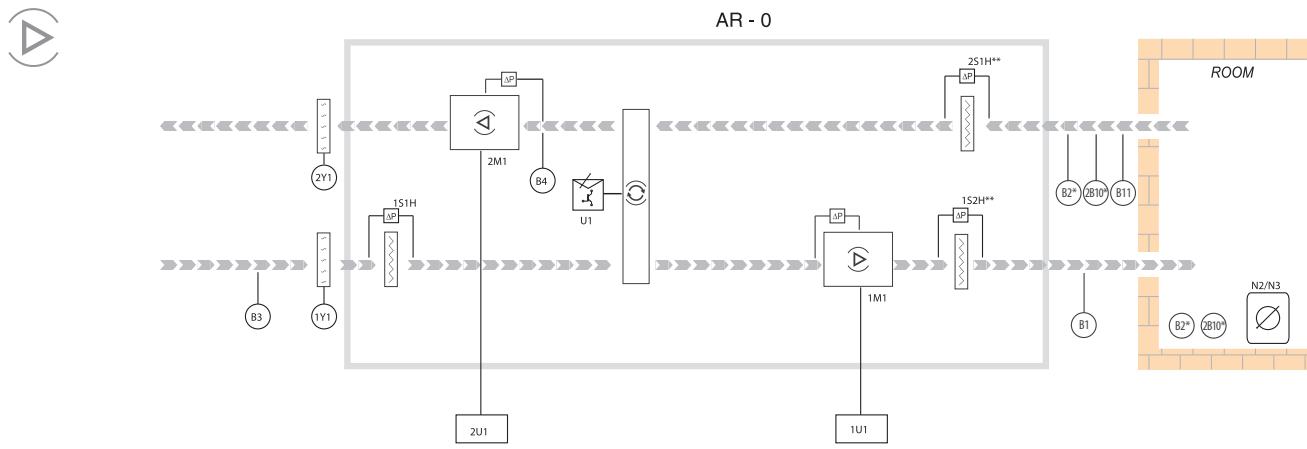

CONTROL

- » control of room temperature, optionally supply or exhaust air temperature
 - » control of the energy recovery level – first stage of heating/cooling
 - » air flow control
 - » operation according to calendar – temperature, efficiency, operation mode (OPERATION, STAND-BY, STOP)
 - » STAND-BY – maintaining the minimum, set indoor temperature
- * Initial heating of external air.

INFORMATION

- » information on outdoor, supply, exhaust and indoor air temperatures
- » filter contamination info
- » alarm status info
- » analog and digital input and output status info

PROTECTION

- » limiting the allowed supply air temperature
- » fan unit protection – the function is active:
 - if an electric heater is applied
- » overload protection of drive unit
- » anti-frost protection of a water heater
- » protection against overheating of an electric heater
- » anti-frost protection of an energy recovery exchanger
- » optional protection against minimal and maximal temperature of medium returning from the water heater with use of Strap-on temperature sensor, standard NTC 10K
- » the control application layouts have been prepared on the basis of water exchangers
- » the quantity of applied pressure switches for filters depends on the filters' configuration
- » optional Strap-on temperature sensor is not a part of VTS offer

CONTROL

- » control of room temperature, optionally supply or exhaust air temperature
 - » control of the energy recovery level – first stage of heating/cooling
 - » air flow control
 - » operation according to calendar – temperature, efficiency, operation mode (OPERATION, STAND-BY, STOP)
 - » STAND-BY – maintaining the minimum, set indoor temperature
- * Initial heating of external air.

INFORMATION

- » information on outdoor, supply, exhaust and indoor air temperatures
- » filter contamination info
- » alarm status info
- » analog and digital input and output status info

PROTECTION

- » limiting the allowed supply air temperature
- » fan unit protection – the function is active:
 - if an electric heater is applied
- » overload protection of a drive unit
- » anti-frost protection of a water heater
- » protection against overheating of an electric heater
- » anti-frost protection of an energy recovery exchanger
- » optional protection against minimal and maximal temperature of medium returning from the water heater with use of Strap-on temperature sensor, standard NTC 10K
- » the control application layouts have been prepared on the basis of water exchangers
- » the quantity of applied pressure switches for filters depends on the filters' configuration
- » optional Strap-on temperature sensor is not a part of VTS offer



 06
Functions



| Direct drive plenum fan

Energy efficient fans are based on single inlet, air foil backward curved radial impellers with 7 blades made of a composite material to minimize the impeller weight and provide the best operating performance and provide the best dynamically balanced operating performance.



PLENUM FAN MOTOR

Fans are driven by TEFC (Totally Enclosed Fan Cooled) foot mounted motors with double shielded bearings and range from 1 HP to 15 HP. Nominal frequency: 60 Hz. Insulation class: F. Efficiency class: Premium. Bearings live: $L_{10} = 20,000$ h, $L_{50} = 100,000$ h. Shaft grounding rings available (on request).

Fan sets used in submitted air handling units are available in a wide range of voltages: 115V/1PH/60Hz, 208V/ 1PH/60Hz, 230V/1PH/60Hz, 208V/3PH/60Hz, 230V/3PH/60Hz, 460V/3PH/60Hz, 575V/3PH.

AMCA



VTS Group certifies that the VS fan series shown herein are licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 211 and AMCA Publication 311 and comply with the requirements of the AMCA Certified Ratings Program. The certified ratings for the VS Fans are shown in this catalogue.

| Air-to-air energy recovery systems

AIR-TO-AIR ENERGY WHEEL

The total energy wheel is constructed with 7.9 inch Aluminum coated with non-toxic, non-corrosive Silica gel in a way that allows it to exchange sensible and latent heat between two airstreams, generally outside air and exhaust air. In the cooling mode, the wheel pre-treats the outside air by transferring sensible and latent heat to the exhaust stream. During the heating mode, the wheel pre-treats the outside air with sensible and latent heat from the exhaust air. This energy recovery is done without total separation of the supply and exhaust air flows with air leakages of 2% to 5%.



CROSS-FLOW PLATE

Cross-Flow plate is an indirect energy recovery device, that transfers heat from the exhaust air stream to the entering air stream which will be supplied to the space. Heat recovery at very high separation of the stream of supply and exhaust air (99.9%). Application in block supply-exhaust AHUs.



FLAT PREFILTER


All units have a two or four inches flat prefector or a combination thereof

- MERV8 two-inch filter.
- MERV13 four-inch filter.

HEATERS

Heaters are available in the following versions:


- hot water heating coils,
- resistant electric heaters,
- DX heating coils.



COOLING COILS

The cooling coils are available either as a hydronic or a DX cooling coils.

The variety of coil types allows a user to select a coil that is optimized for pressure drop and capacity requirements. The cooling coils are mounted over the drainpan to ensure water condensate flowing.





AIR DAMPERS

VTS Group certifies that the dampers shown herein are licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA International Certified Ratings Seal applies to Air Performance and Air Leakage. The VTS air dampers are in 3rd class for 1, 4 and 8 in. w.g.

Leakage testing conducted in accordance with AMCA Standard 500-D-07 figure 5.4 Alternate. Data are based on a torque of 10 in-lb/ft² applied to close and seal the damper during the test. Air leakage is based on operation between 32 to 120 F. All data corrected to represent standard air density 0.075 lb/ft³.

Pressure drop testing conducted in accordance with AMCA Standard 500-D-07 figure 5.3. All data corrected to represent standard air density 0.075 lb/ft³.

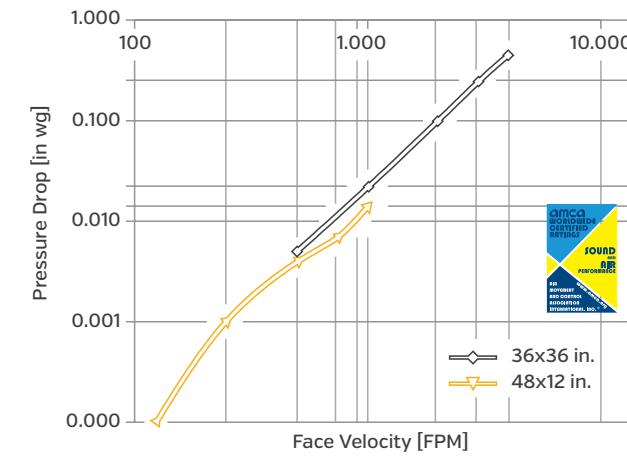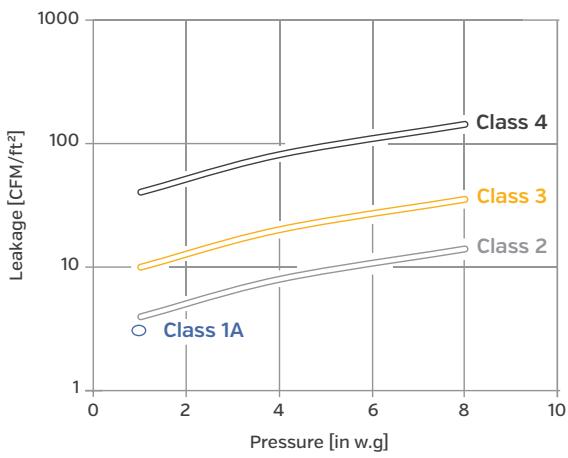


PSYCHROMETRIC CHART

Normal Temperature

Barometric Pressure: 29.921 Inches of Mercury

Sea Level

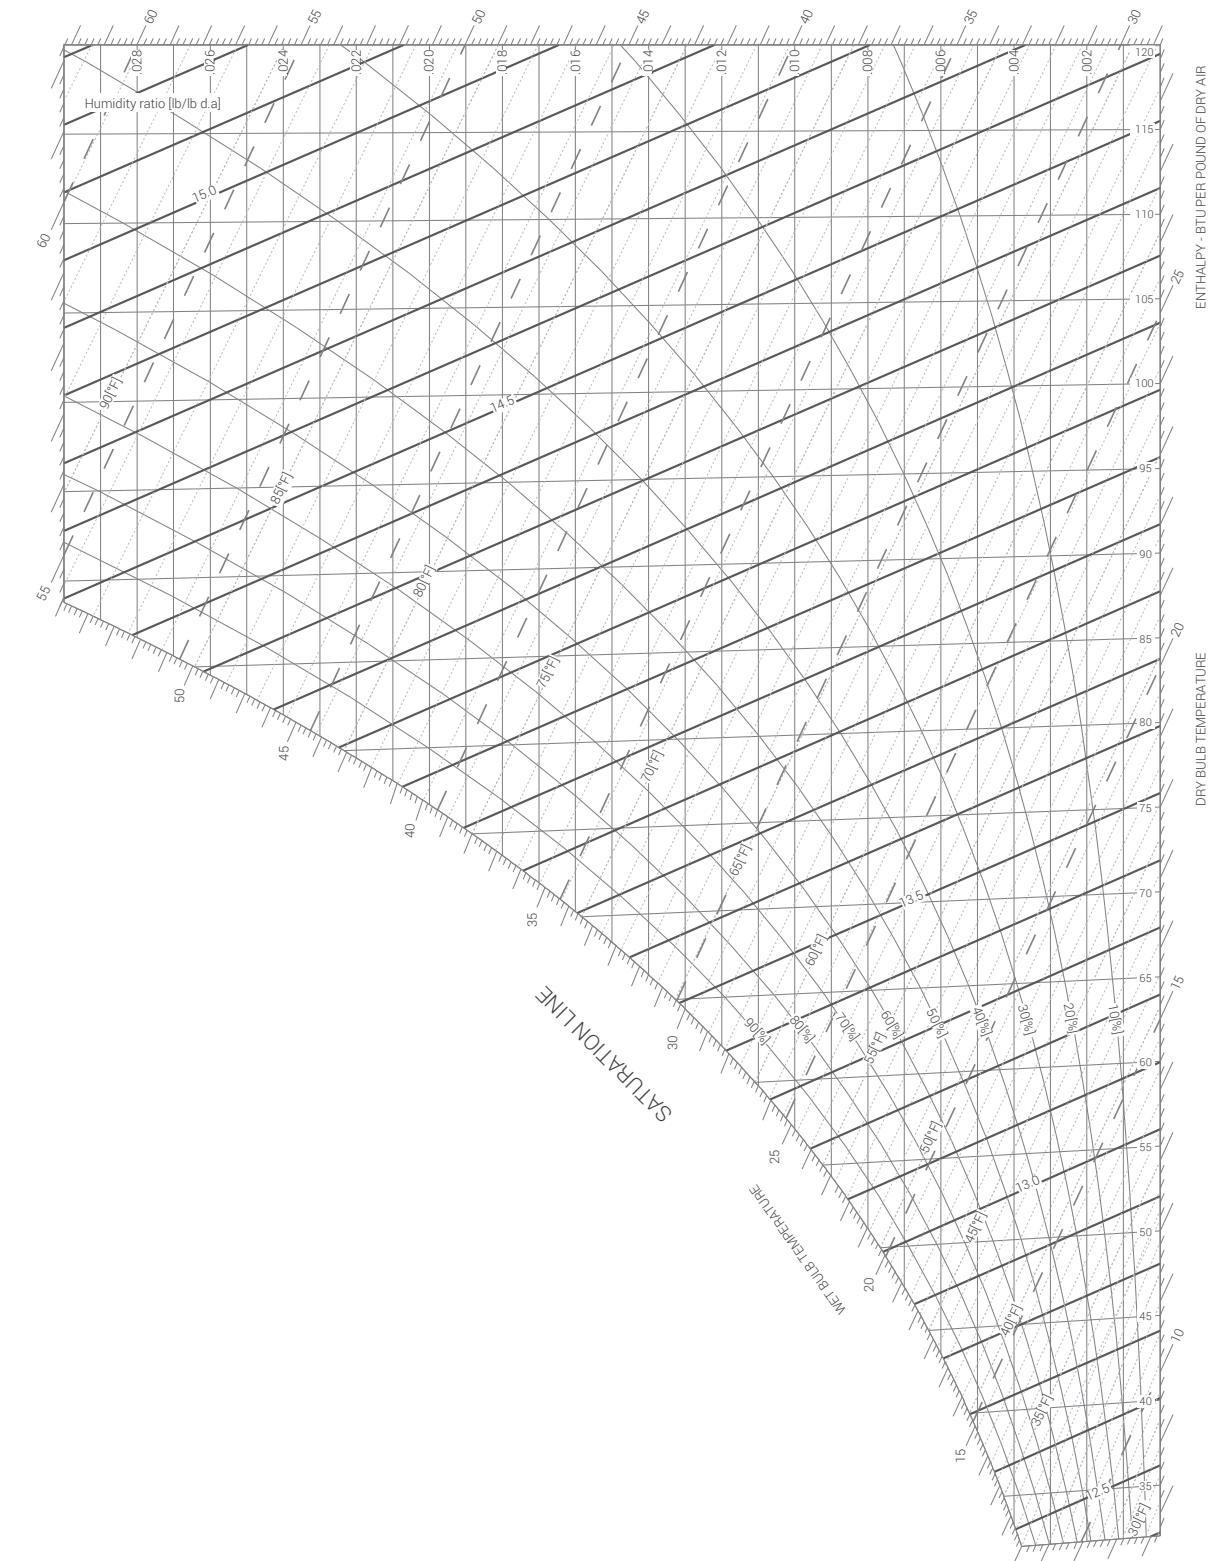

Certified fan performance data for fans of LDX 225 - LDX 400 sizes



| Unit Size | Q [cfm] | Ps [in. wg] | BHP [hp] |
|---------------------|---------|-------------|----------|
| LDX-225 4000 RPM | 1204 | 0,00 | 0,620 |
| | 1123 | 0,74 | 0,664 |
| | 1038 | 1,47 | 0,718 |
| | 973 | 1,90 | 0,753 |
| | 848 | 2,62 | 0,804 |
| | 784 | 2,92 | 0,819 |
| | 687 | 3,25 | 0,813 |
| | 602 | 3,53 | 0,801 |
| | 525 | 3,72 | 0,784 |
| | 347 | 4,16 | 0,719 |
| | 0 | 4,78 | 0,467 |
| | 1822 | 0,00 | 1,045 |
| | 1685 | 1,01 | 1,175 |
| | 1557 | 1,84 | 1,249 |
| LDX-250 3900 RPM | 1460 | 2,54 | 1,321 |
| | 1365 | 3,07 | 1,392 |
| | 1303 | 3,38 | 1,412 |
| | 1259 | 3,59 | 1,431 |
| | 1172 | 3,93 | 1,443 |
| | 996 | 4,49 | 1,420 |
| | 820 | 4,68 | 1,312 |
| | 0 | 5,95 | 0,685 |
| | 3036 | 0,00 | 1,360 |
| | 2854 | 0,67 | 1,537 |
| | 2666 | 1,54 | 1,742 |
| | 2492 | 2,40 | 1,922 |
| | 2244 | 3,27 | 2,131 |
| | 2002 | 3,90 | 2,235 |
| LDX-315 3250 RPM | 1752 | 4,42 | 2,258 |
| | 1574 | 4,69 | 2,212 |
| | 1360 | 5,03 | 2,126 |
| | 913 | 5,44 | 1,812 |
| | 0 | 6,16 | 0,912 |
| | 4102 | 0,00 | 2,487 |
| | 3700 | 1,68 | 2,989 |
| | 3318 | 3,25 | 3,382 |
| | 2841 | 4,63 | 3,714 |
| | 2496 | 5,36 | 3,806 |
| | 2079 | 6,02 | 3,710 |
| | 1655 | 6,48 | 3,478 |
| | 1146 | 6,90 | 3,020 |
| | 990 | 7,01 | 2,922 |
| LDX-355 3200 RPM | 744 | 7,11 | 2,704 |
| | 0 | 7,56 | 1,723 |
| | 4992 | 0,00 | 2,830 |
| | 4481 | 1,92 | 3,554 |
| | 4020 | 3,46 | 4,144 |
| | 3496 | 4,95 | 4,627 |
| | 3007 | 5,93 | 4,761 |
| | 2449 | 6,53 | 4,559 |
| | 2119 | 6,89 | 4,372 |
| | 1593 | 7,31 | 3,956 |
| | 1098 | 7,61 | 3,460 |
| | 786 | 7,75 | 3,138 |
| | 0 | 8,24 | 2,093 |

NOTE 1: Performance certified is for installation Type A, Free Inlet, Free Outlet. Power rating (BHP) does not include transmission losses.
Performance ratings do not include the effects of appurtenances (accessories).

NOTE 2: Efficiency ratings are fan static and exclude bearing and/or Power Transmission Losses.

NOTE 3: VTS America Inc. certifies that the Model VS shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 211 and AMCA Publication 311 and comply with the requirements of the AMCA Certified Ratings Program.

Certified fan performance data for fans of LDX 450 - LDX 630 sizes



| Unit Size | Q [cfm] | Ps [in. wg] | BHP [hp] |
|---------------------|---------|-------------|----------|
| LDX-450 2900 RPM | 6780 | 0,00 | 4,653 |
| | 6124 | 1,94 | 5,807 |
| | 5382 | 4,13 | 6,973 |
| | 4746 | 5,86 | 7,818 |
| | 4132 | 7,08 | 8,153 |
| | 3496 | 7,97 | 8,060 |
| | 3030 | 8,37 | 7,671 |
| | 2712 | 8,58 | 7,335 |
| | 2458 | 8,75 | 7,067 |
| | 1377 | 9,30 | 5,833 |
| | 0 | 10,11 | 3,406 |
| | 8086 | 0,00 | 4,697 |
| | 7289 | 1,65 | 5,474 |
| | 6344 | 3,71 | 6,761 |
| LDX-500 2400 RPM | 5687 | 4,91 | 7,457 |
| | 4873 | 6,01 | 7,910 |
| | 4098 | 6,81 | 7,818 |
| | 3225 | 7,32 | 7,159 |
| | 2585 | 7,60 | 6,603 |
| | 1939 | 7,81 | 5,914 |
| | 1235 | 7,95 | 5,105 |
| | 0 | 8,51 | 3,110 |
| | 10302 | 0,00 | 6,050 |
| | 9274 | 1,57 | 6,938 |
| | 8304 | 3,19 | 7,979 |
| | 7238 | 4,70 | 8,971 |
| | 6346 | 5,64 | 9,321 |
| | 5215 | 6,65 | 9,419 |
| LDX-560 2100 RPM | 4257 | 7,14 | 8,855 |
| | 3096 | 7,49 | 7,760 |
| | 2248 | 7,63 | 6,866 |
| | 1307 | 7,72 | 5,799 |
| | 0 | 8,20 | 3,647 |
| | 11942 | 0,00 | 6,949 |
| | 10783 | 1,49 | 8,085 |
| | 9696 | 2,93 | 9,211 |
| | 8425 | 4,39 | 10,270 |
| | 7117 | 5,48 | 10,511 |
| | 5865 | 6,24 | 10,121 |
| | 4770 | 6,71 | 9,504 |
| | 3598 | 6,94 | 8,522 |
| | 2466 | 7,07 | 7,473 |
| LDX-630 1750 RPM | 1329 | 7,14 | 6,192 |
| | 0 | 7,41 | 4,359 |

NOTE 1: Performance certified is for installation Type A, Free Inlet, Free Outlet. Power rating (BHP) does not include transmission losses.
Performance ratings do not include the effects of appurtenances (accessories).

NOTE 2: Efficiency ratings are fan static and exclude bearing and/or Power Transmission Losses.

NOTE 3: VTS America Inc. certifies that the Model VS shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 211 and AMCA Publication 311 and comply with the requirements of the AMCA Certified Ratings Program.



Certified sound pressure level for fans of LDX 225 - LDX 400 sizes



| Unit Size | Ps [in. wg] | Q [cfm] | Lw Loudness | 63 Hz | 125 Hz | 250 Hz | 500 Hz | 1 kHz | 2 kHz | 4 kHz | 8 kHz | Lw[A] dB[A] | Loudness Sones | |
|---------------------|----------------------|---------|-------------|-------|--------|--------|--------|-------|-------|-------|-------|-------------|----------------|-------|
| LDX-225 4000 RPM | 0,74 | 1123 | dB | 101,6 | 83,9 | 85,4 | 79,8 | 77,7 | 73,5 | 73,1 | 75,1 | 84 | 48,6 | |
| | | | Sones | 164,8 | 48,3 | 53,6 | 36,3 | 31,4 | 23,5 | 22,8 | 26,2 | | | |
| | 2,62 | 848 | dB | 109,5 | 75,2 | 72,8 | 76,0 | 75,3 | 70,4 | 70,0 | 66,2 | 85 | 52,1 | |
| | | | Sones | 285,0 | 26,4 | 22,4 | 27,9 | 26,6 | 18,9 | 18,4 | 14,1 | | | |
| | 3,53 | 602 | dB | 110,2 | 75,5 | 76,5 | 77,4 | 75,6 | 70,0 | 69,1 | 64,6 | 85 | 52,1 | |
| | | | Sones | 299,2 | 27,0 | 28,9 | 30,8 | 27,1 | 18,4 | 17,3 | 12,7 | | | |
| | 4,78 | 0 | dB | 112,0 | 82,0 | 84,7 | 80,9 | 78,6 | 72,7 | 71,7 | 66,0 | 88 | 64,2 | |
| | | | Sones | 338,9 | 42,3 | 51,0 | 39,2 | 33,4 | 22,2 | 20,7 | 14,0 | | | |
| | LDX-250 3900 RPM | 1,01 | 1685 | dB | 109,9 | 77,8 | 83,4 | 80,3 | 77,3 | 73,7 | 76,2 | 85,3 | 89 | 68,8 |
| | | | | Sones | 293,0 | 31,6 | 46,6 | 37,6 | 30,5 | 23,8 | 28,3 | 53,2 | | |
| | | 3,07 | 1365 | dB | 105,4 | 77,8 | 78,7 | 78,3 | 76,5 | 72,5 | 81,1 | 78 | 86 | 55,8 |
| | | | | Sones | 214,4 | 31,6 | 33,7 | 32,7 | 28,9 | 21,9 | 39,8 | 32,1 | | |
| | | 3,93 | 1172 | dB | 101,4 | 76,3 | 79,4 | 75,5 | 74,4 | 72 | 77,1 | 71,1 | 83 | 45,4 |
| | | | | Sones | 162,5 | 28,5 | 35,3 | 27,0 | 25,0 | 21,1 | 30,1 | 19,9 | | |
| | | 5,95 | 0 | dB | 99,7 | 83,2 | 88 | 83,6 | 79,9 | 74 | 73,3 | 68,6 | 86 | 55,8 |
| | | | | Sones | 144,4 | 46,0 | 64,2 | 47,3 | 36,6 | 24,3 | 23,1 | 16,7 | | |
| | LDX-315 3250 RPM | 0,67 | 2854 | dB | 107,3 | 83,6 | 81,7 | 82,5 | 75,8 | 76,3 | 80,6 | 80,3 | 88 | 64,2 |
| | | | | Sones | 244,7 | 47,3 | 41,4 | 43,8 | 27,5 | 28,5 | 38,4 | 37,6 | | |
| | | 3,27 | 2244 | dB | 106,1 | 78,6 | 80,9 | 79,1 | 72,9 | 73,7 | 73,7 | 73,1 | 84 | 48,6 |
| | | | | Sones | 225,1 | 33,4 | 39,2 | 34,6 | 22,5 | 23,8 | 23,8 | 22,8 | | |
| | | 4,69 | 1574 | dB | 105,2 | 81 | 82,9 | 81,4 | 73,6 | 74,2 | 72,8 | 68,9 | 84 | 48,6 |
| | | | | Sones | 211,5 | 39,5 | 45,0 | 40,6 | 23,6 | 24,6 | 22,4 | 17,1 | | |
| | | 6,16 | 0 | dB | 106,4 | 87,4 | 88 | 85,7 | 79,8 | 76,9 | 74,8 | 70 | 88 | 64,2 |
| | | | | Sones | 229,9 | 61,5 | 64,2 | 54,7 | 36,3 | 29,7 | 25,7 | 18,4 | | |
| | LDX-355 3 200 RPM | 1,68 | 3700 | dB | 107,8 | 79,6 | 85 | 83,5 | 80,1 | 85,9 | 89,7 | 79,1 | 93 | 90,7 |
| | | | | Sones | 253,3 | 35,8 | 52,1 | 47,0 | 37,1 | 55,5 | 72,2 | 34,6 | | |
| | | 5,36 | 2496 | dB | 104,9 | 79,8 | 80,5 | 80,7 | 77,4 | 85,5 | 87,1 | 75,7 | 91 | 79,0 |
| | | | | Sones | 207,1 | 36,3 | 38,1 | 38,7 | 30,8 | 53,9 | 60,3 | 27,3 | | |
| | | 6,90 | 1146 | dB | 103,9 | 92,5 | 97,3 | 89,6 | 81,8 | 85,8 | 87 | 74,9 | 94 | 97,3 |
| | | | | Sones | 193,3 | 87,7 | 122,3 | 71,7 | 41,7 | 55,1 | 59,9 | 25,9 | | |
| | | 7,56 | 0 | dB | 102,3 | 89,4 | 91,6 | 89,8 | 83,9 | 85,5 | 86,6 | 74,6 | 93 | 90,7 |
| | | | | Sones | 173,0 | 70,7 | 82,3 | 72,7 | 48,3 | 53,9 | 58,2 | 25,3 | | |
| | LDX-400 2950 RPM | 1,92 | 4481 | dB | 96,3 | 85 | 92,8 | 90,2 | 86,9 | 86,8 | 91,5 | 86,3 | 96 | 111,7 |
| | | | | Sones | 114,1 | 52,1 | 89,5 | 74,7 | 59,4 | 59,0 | 81,8 | 57,0 | | |
| | | 5,93 | 3007 | dB | 98,2 | 79,7 | 86,4 | 84,1 | 80,8 | 82 | 82,9 | 84,8 | 90 | 73,7 |
| | | | | Sones | 130,2 | 36,1 | 57,4 | 49,0 | 38,9 | 42,3 | 45,0 | 51,4 | | |
| | | 7,31 | 1593 | dB | 100,2 | 93,1 | 99,7 | 90,6 | 82,7 | 81,9 | 82,4 | 83,3 | 94 | 97,3 |
| | | | | Sones | 149,5 | 91,4 | 144,4 | 76,8 | 44,4 | 42,0 | 43,5 | 46,3 | | |
| | | 8,24 | 0 | dB | 98,9 | 89,9 | 94,2 | 90,3 | 84,6 | 83,3 | 81,3 | 77,6 | 92 | 84,7 |
| | | | | Sones | 136,6 | 73,2 | 98,6 | 75,2 | 50,7 | 46,3 | 40,3 | 31,2 | | |

NOTE 1: The sound power level ratings shown are in decibels, referred to 10-12 watts, calculated per AMCA Standard 301. Values shown are for outlet LwA sound power levels and outlet hemispherical sone levels for installation type A:Free Inlet, Free Outlet, calculated per AMCA Standard 301. The AMCA Certified Ratings Seal applies to Air performance and sound.

NOTE 2: VTS America Inc. certifies that the Model VS shown herein is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 211 and AMCA Publication 311 and comply with the requirements of the AMCA Certified Ratings Program."

Certified sound pressure level for fans of LDX 450 - LDX 630 sizes



| Unit Size | Ps [in. wg] | Q [cfm] | Lw Loudness | 63 Hz | 125 Hz | 250 Hz | 500 Hz | 1 kHz | 2 kHz | 4 kHz | 8 kHz | Lw[A] dB[A] | Loudness Sones |
|---------------------|-------------|---------|-------------|-------|--------|--------|--------|-------|-------|-------|-------|-------------|----------------|
| LDX-450 2900 RPM | 1,94 | 6124 | dB | 117 | 94 | 97 | 94 | 92 | 92 | 95 | 85 | 10 | |



SYMBOLS AND LABELS

Basic symbols

| PROCESS | | | FUNCTION |
|---------|---------|-----------------|---|
| Symbol | Graphic | Name | Options of functions |
| F | | AIR FILTRATION | FILTER |
| V | | VENTILATION | FAN |
| C | | AIR COOLING | HYDRONIC COOLING COIL DX COOLING COIL RUN-AROUND COIL |
| H | | AIR HEATING | HYDRONIC HEATING COIL ELECTRIC HEATER DX HEATING STEAM HEATER RUN-AROUND COIL |
| M | | MIXING BOX | MIXING BOX |
| P | | ENERGY RECOVERY | CROSS FLOW PLATE |
| R | | ENERGY RECOVERY | ENERGY WHEEL |

Auxiliary symbols

| Symbol | Graphic | Name |
|--------|---------|---------------------|
| FC | | FLEXIBLE CONNECTION |
| AD | | DAMPER |
| FLG | | FLANGES |
| E | | EMPTY SECTION |



VTS America, Inc.
3535 Gravel Springs Road Ext
Suite 201
Buford, GA 30519
United States of America
Tel: 470-809-6811
Fax: 470-809-6815
e-mail: america@vtsgroup.com

Catalog Version: January, 2025

The features mentioned are subject to continuous upgrade and can change any time.
VTS assuring continuous improvement for product and data and reserves the right to change design and specifications without notice.

www.vtsgroup.com